


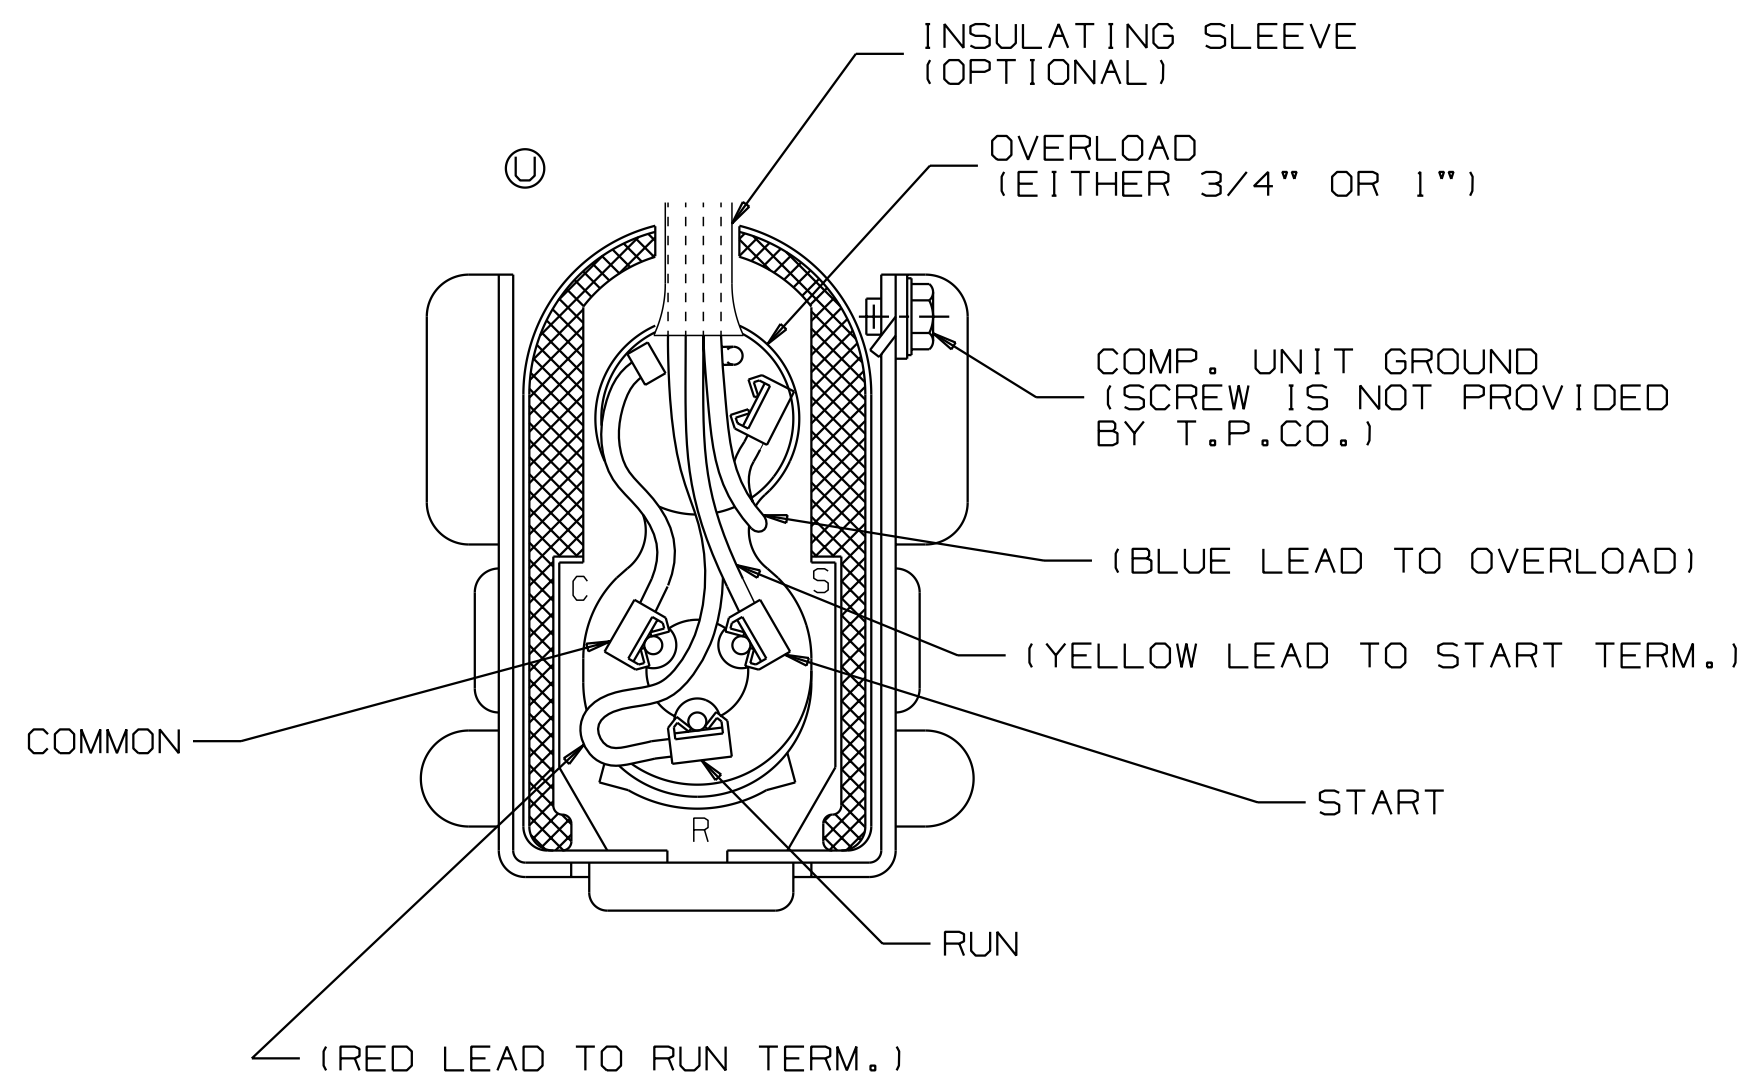


ELECTRICAL HOOK-UP
REF. DEAK1

--NOTES--

1. ASSEMBLE PARTS ASH SHOWN IS SPECIFIED ON B/M.
2. IDENTIFIED CONDUCTOR MAYBE WHITE OR RIBBED (115 VOLT ONLY - NEUTRAL).
3. SCREW TERM. RELAY REQUIRED WHEN RELAY IS MOUNTED IN ELECT. BOX 90991. SPADE TERM. RELAY FOR REMOTE MOUNTING (ALTERNATE).

WARNING-WIRING DIAGRAM MUST BE FOLLOWED
AS SHOWN. ANY MISWIRING CAN CAUSE SERIOUS
ELECTRICAL HAZARD AND POTENTIAL DAMAGE
OR RUPTURE OF COMPONENT ELECTRICAL PARTS.

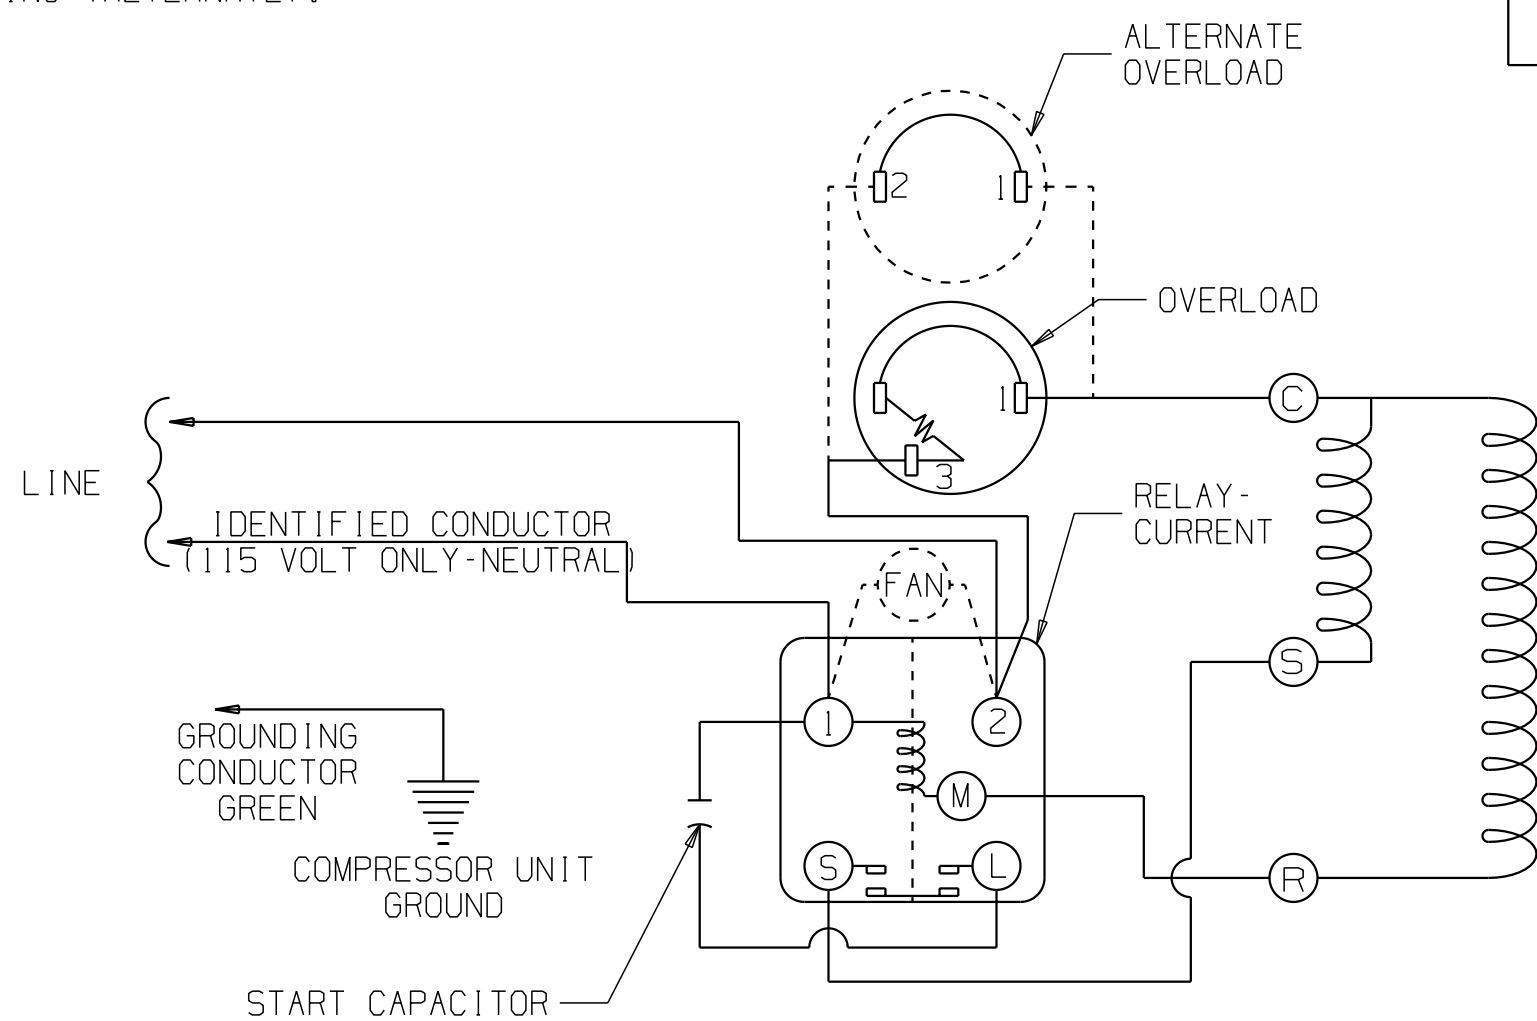

AK-115 OR 230 VOLT - CSIR - CURRENT RELAY

Q.A. SYMBOLS

AK

115 OR 230 VOLT-SCHEMATIC WIRING DIAGRAM -CSIR-
CURRENT RELAY
(REF.DWG. MD472-9)

ELECTRICAL HOOK-UP

TECUMSEH PRODUCTS CO.
TECUMSEH, MICHIGAN

MATERIAL

INTERNAL USE ONLY
UG11D1SK511 HINMAN JAK-DEAK02_T-C.PRT

PART NO.

DEAK2

THIS DRAWING OR PRINT (1) IS THE PROPERTY OF TECUMSEH PRODUCTS COMPANY AND IS LOANED TO THE RECIPIENT ON THE EXPRESS UNDERSTANDING THAT IT IS TO BE USED ONLY FOR THE PURPOSES SPECIFIED AND IS NOT TO BE REPRODUCED, COPIED, OR IN ANY MANNER DISCLOSED TO OTHERS WITHOUT THE EXPRESS AND WRITTEN CONSENT OF TECUMSEH. AND THAT SUCH INFORMATION APPROVED IN WRITING BY TECUMSEH AND NOT OTHERWISE (1)I SHALL NOT BE USED FOR ANY PURPOSES OTHER THAN SPECIFIC WRITTEN CONSENT AND (1)I SHALL BE RETURNED BY THE RECIPIENT TO THE LATTERS REQUEST PROMPTLY AFTER SUCH REQUEST IS MADE.

DO NOT SCALE DRAWING ALL FERROUS MATERIALS MUST NOT BE MOUNTED AS RECOMMENDED COMPRESSOR ASSEMBLY.

DIS.CODE NAME

SCALE
1" = 1"

THIS PRINT SUPERSEDES ALL PRINTS PRIOR TO

DATE

CHANGE

NO CHANGE

REDAWN

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS