


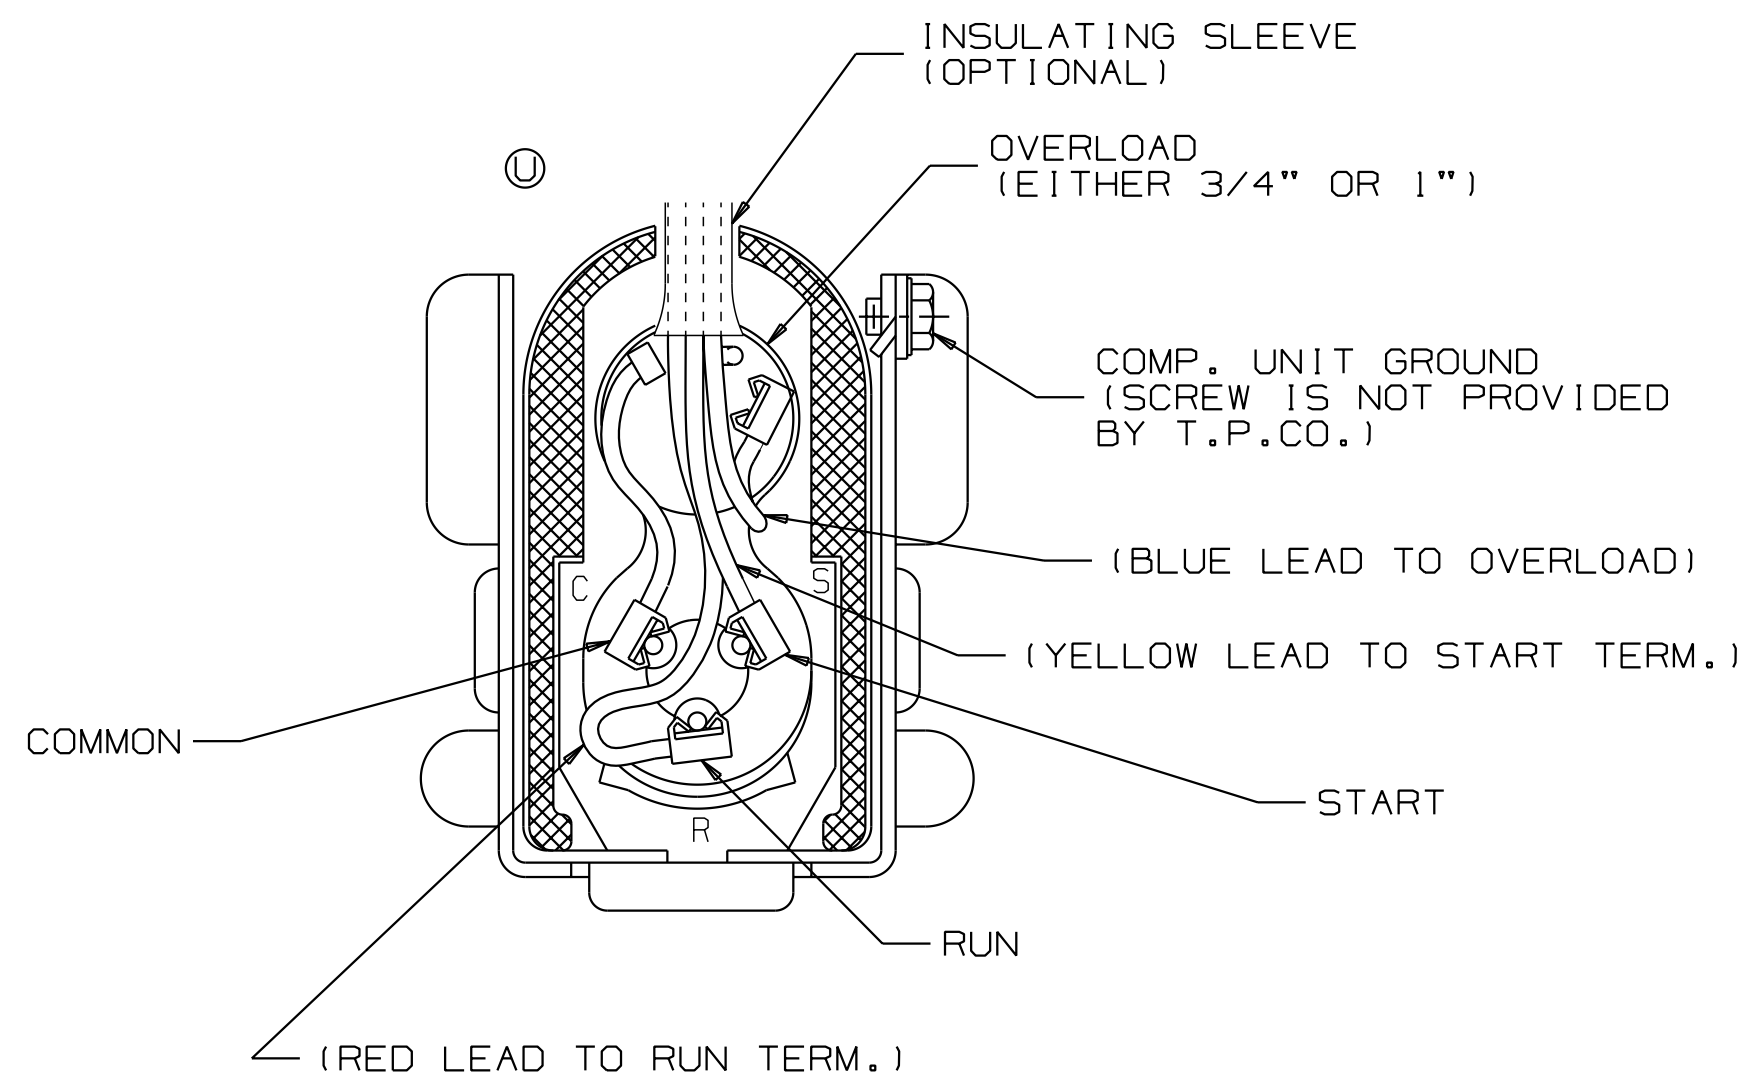


ELECTRICAL HOOK-UP  
REF. DEAK1

--NOTES--

1. ASSEMBLE PARTS AS SHOWN IS SPECIFIED ON B/M.
2. IDENTIFIED CONDUCTOR MAYBE WHITE OR RIBBED (115 VOLT ONLY - NEUTRAL).
3. SCREW TERM. RELAY REQUIRED WHEN RELAY IS MOUNTED IN ELECT. BOX 90991. SPADE TERM. RELAY FOR REMOTE MOUNTING (ALTERNATE).

WARNING-WIRING DIAGRAM MUST BE FOLLOWED  
AS SHOWN. ANY MISWIRING CAN CAUSE SERIOUS  
ELECTRICAL HAZARD AND POTENTIAL DAMAGE  
OR RUPTURE OF COMPONENT ELECTRICAL PARTS.

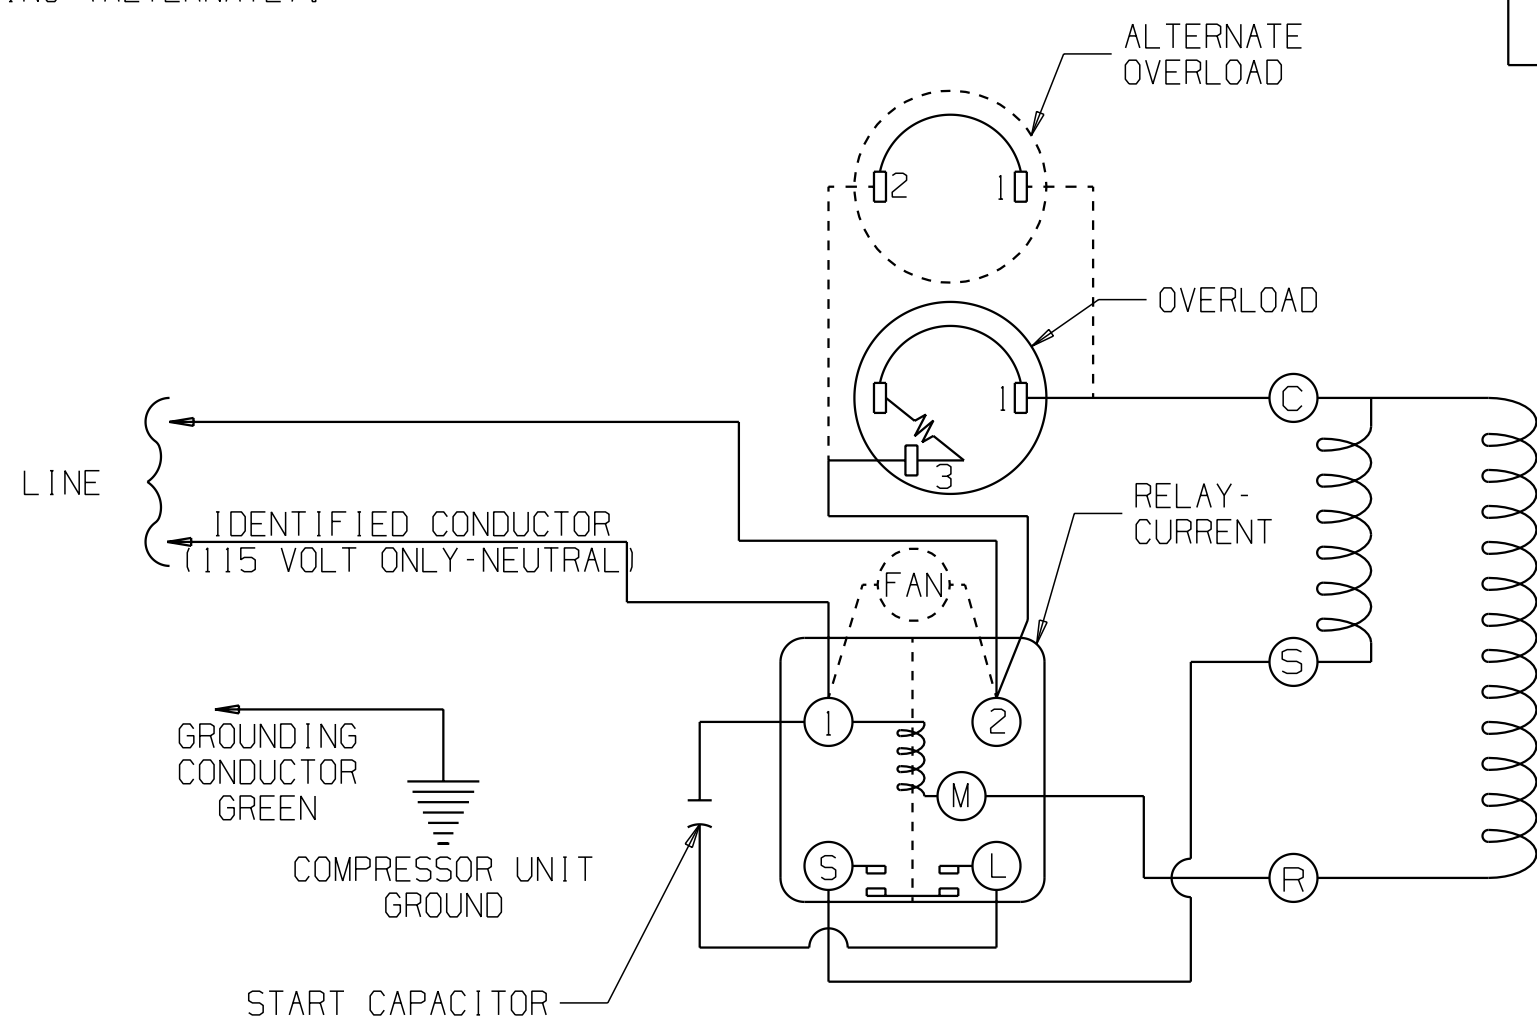

115 OR 230 VOLT-SCHEMATIC WIRING DIAGRAM -CSIR-  
CURRENT RELAY  
(REF.DWG. MD472-9)

AK-115 OR 230 VOLT - CSIR - CURRENT RELAY

Q.A. SYMBOLS

AK

| DIS.CODE | NAME                                                     | SCALE   | THIS PRINT SUPERSEDES ALL PRINTS PRIOR TO |
|----------|----------------------------------------------------------|---------|-------------------------------------------|
|          | ELECTRICAL HOOK-UP                                       | 1" = 1" |                                           |
|          | <b>TECUMSEH PRODUCTS CO.</b><br>TECUMSEH, MICHIGAN       |         | PART NO.                                  |
|          | MATERIAL                                                 |         | DEAK2                                     |
|          | INTERNAL USE ONLY<br>UG11D1SK5:H1NMAN JAK-DEAK02_T-C.PRT |         |                                           |