


ELECTRICAL HOOK-UP  
REF. DEAK1

--NOTES--

1. ASSEMBLE PARTS ASH SHOWN IS SPECIFIED ON B/M.
2. IDENTIFIED CONDUCTOR MAYBE WHITE OR RIBBED (115 VOLT ONLY - NEUTRAL).
3. SCREW TERM. RELAY REQUIRED WHEN RELAY IS MOUNTED IN ELECT. BOX 90991. SPADE TERM. RELAY FOR REMOTE MOUNTING (ALTERNATE).

WARNING-WIRING DIAGRAM MUST BE FOLLOWED AS SHOWN. ANY MISWIRING CAN CAUSE SERIOUS ELECTRICAL HAZARD AND POTENTIAL DAMAGE OR RUPTURE OF COMPONENT ELECTRICAL PARTS.

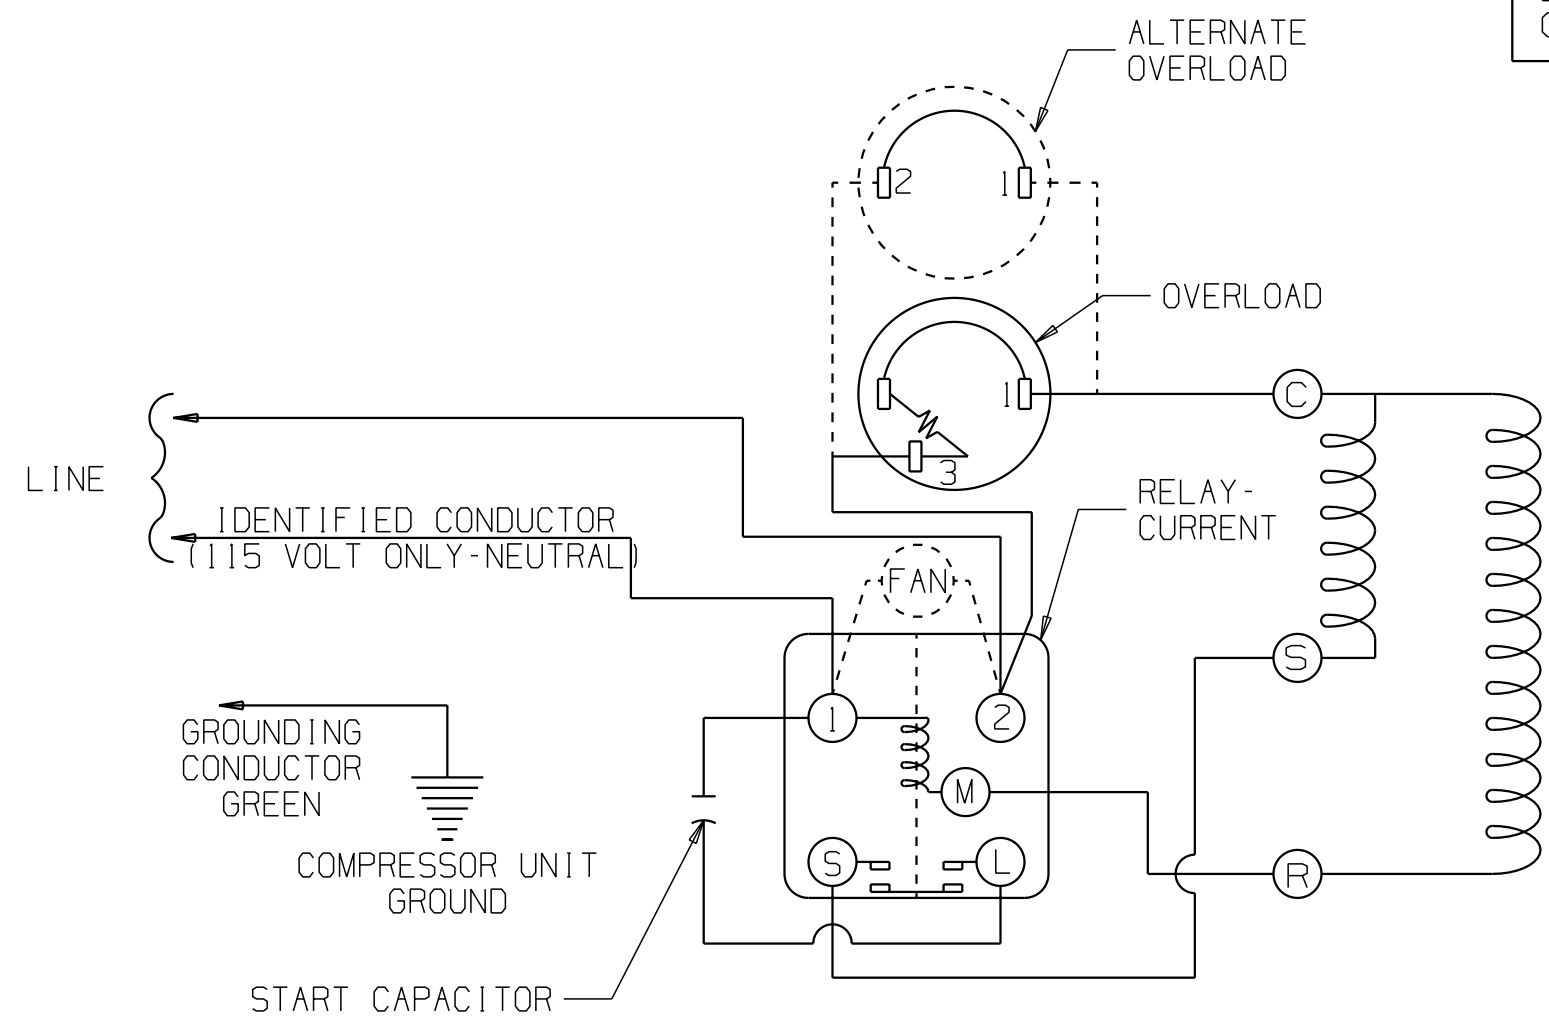

115 OR 230 VOLT-SCHEMATIC WIRING DIAGRAM -CSIR-  
CURRENT RELAY  
(REF.DWG. MD472-9)

AK-115 OR 230 VOLT - CSIR - CURRENT RELAY

Q.A. SYMBOLS

AK

U	7E	EC19615	LOT	08JUL08	DATE	---	CHANGE	---	DATE	---	DIS.CODE	NAME	ELECTRICAL HOOK-UP		
T	---	4231504-022	REVISE	WIRE	HINMAN	---	---	---	---	---	SCALE	1" = 1"	THIS PRINT SUPERSEDES ALL PRINTS PRIOR TO		
S	---	---	REVISION	ROUTING	OVERLOAD HOLDER	---	---	---	---	---	MATERIAL	PART NO.			
												TECUMSEH PRODUCTS CO.		DEAK2	
												TECUMSEH, MICHIGAN			
												INTERNAL USE ONLY			
												UG11D1SK5:1 HINMAN JAK-DEAK02_T-C.PRT			