


PART NO. 90537-30

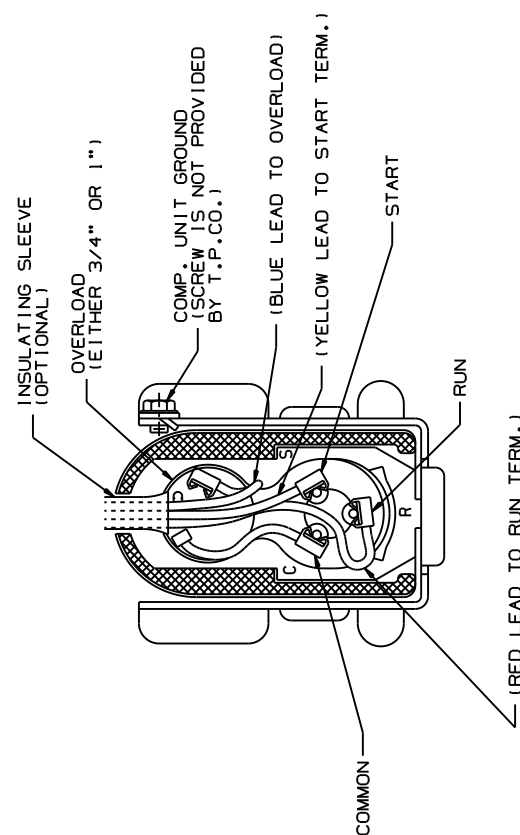


ELECTRICAL HOOK - UP

NOTES


1. ASSEMBLE PARTS AS SHOWN IS SPECIFIED ON B/M.
IDENTIFIED CONDUCTOR MAYBE WHITE OR RIBBED
1115 VOLT ONLY - NEUTRAL.
2. SCREW TERM. RELAY REQUIRED WHEN RELAY IS MOUNTED IN
ELECT. BOX 90991. SPADE TERM. RELAY FOR REMOTE
MOUNTING (ALTERNATE).

WARNING-WIRING DIAGRAM MUST BE FOLLOWED AS SHOWN. ANY MISWIRING CAN CAUSE SERIOUS ELECTRICAL HAZARD AND POTENTIAL DAMAGE OR RUPTURE OF COMPONENT ELECTRICAL PARTS.

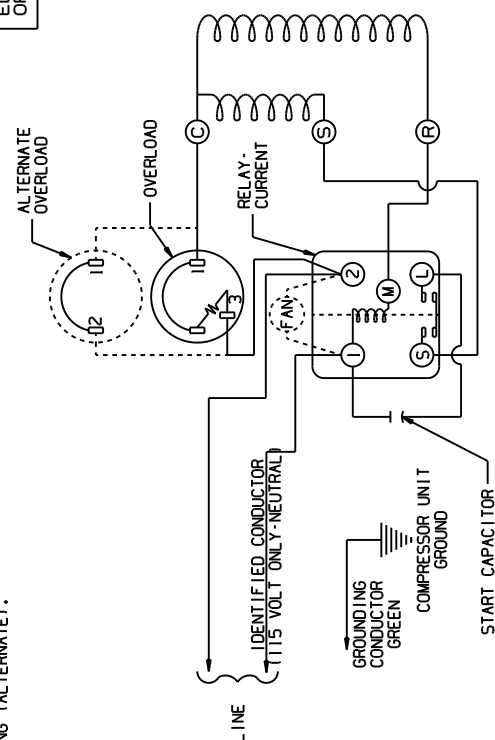115 OR 230 VOLT - SCHEMATIC WIRING DIAGRAM - CSIR -
CURRENT RELAY

K-115 OR 230 VOLT · CSIR · CURRENT RELAY

PART NO.
90537-30

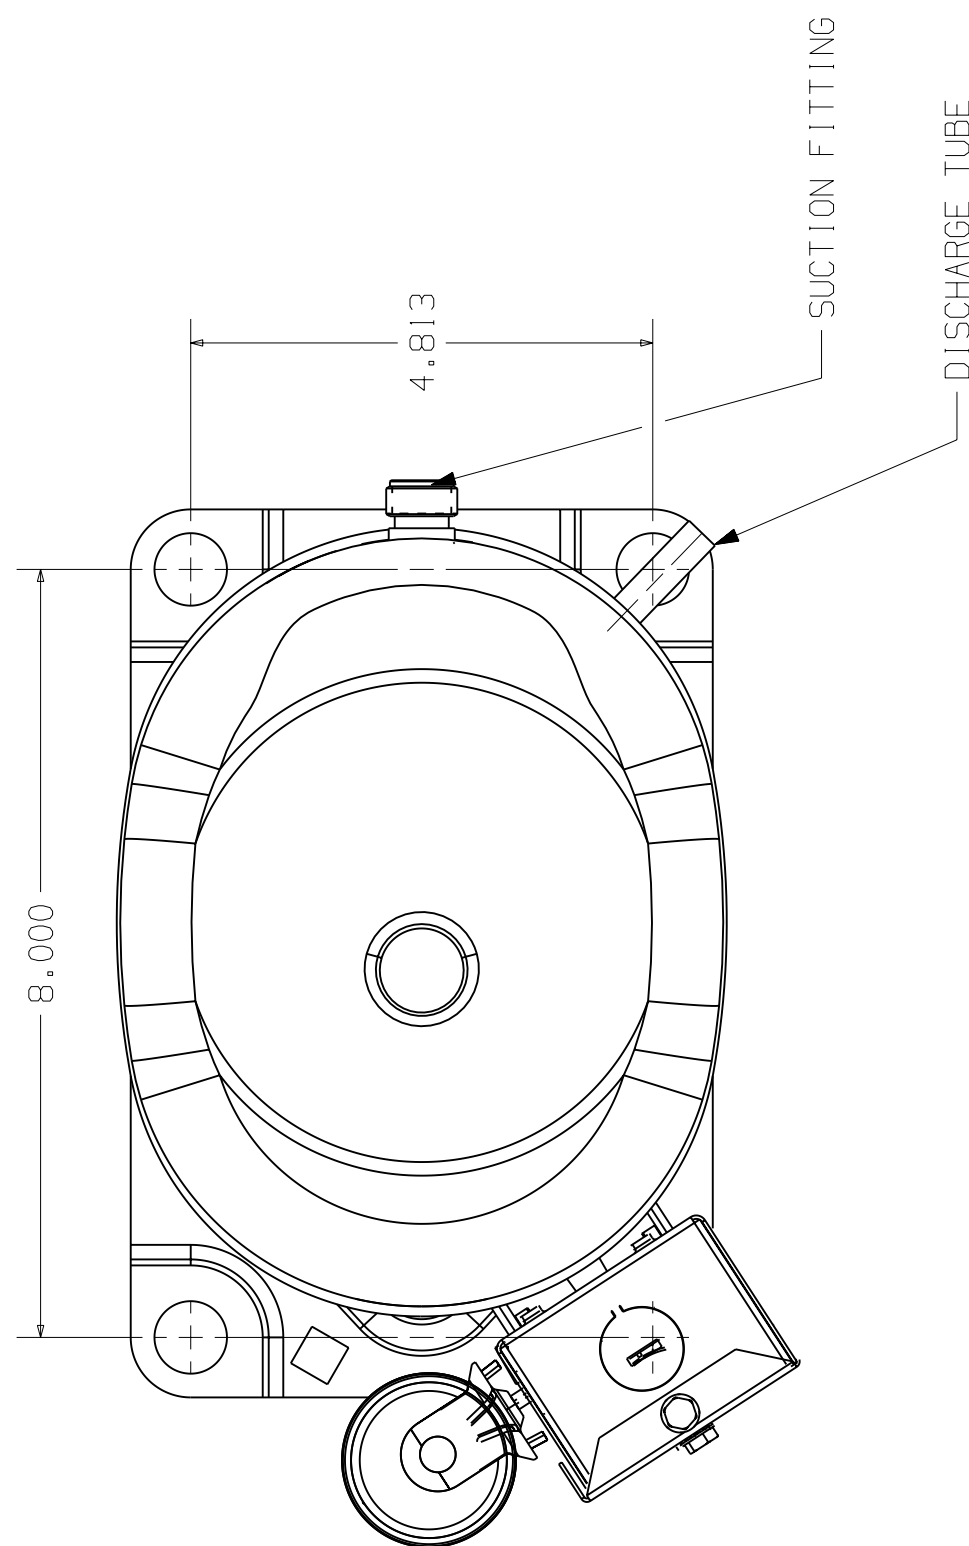

NOTE:
APPROXIMATE LOCATION OF SUCTION &
DISCHARGE TUBES FOR "AK" COMPRESSORS

Ⓐ SIDE A

Ⓐ SIDE B

NOTE :

1. DUPLEX SIDE A AND B ON 8 1/2 x 11 WHITE PAPER.
2. REFERENCE DEAK2.
- ▲ 3. MUST COMPLY WITH T.P.Co. GLOBAL SPEC. 08.

[illegible]