PART NO. DEAK2

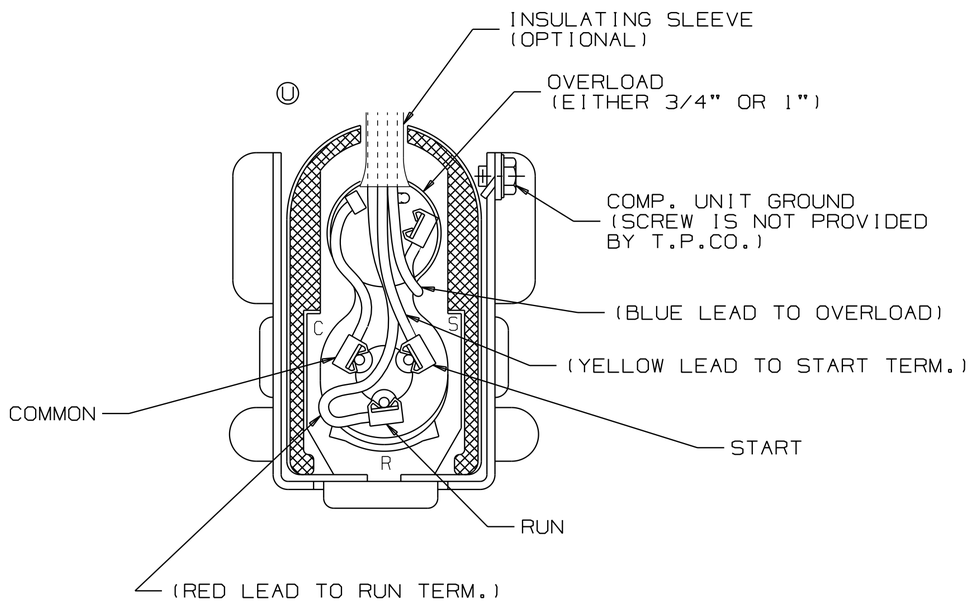

ELECTRICAL HOOK-UP
REF. DEAK1

--NOTES--

1. ASSEMBLE PARTS ASH SHOWN IS SPECIFIED ON B/M.
2. IDENTIFIED CONDUCTOR MAYBE WHITE OR RIBBED (115 VOLT ONLY - NEUTRAL).
3. SCREW TERM. RELAY REQUIRED WHEN RELAY IS MOUNTED IN ELECT. BOX 90991. SPADE TERM. RELAY FOR REMOTE MOUNTING (ALTERNATE).

WARNING-WIRING DIAGRAM MUST BE FOLLOWED AS SHOWN. ANY MISWIRING CAN CAUSE SERIOUS ELECTRICAL HAZARD AND POTENTIAL DAMAGE OR RUPTURE OF COMPONENT ELECTRICAL PARTS.

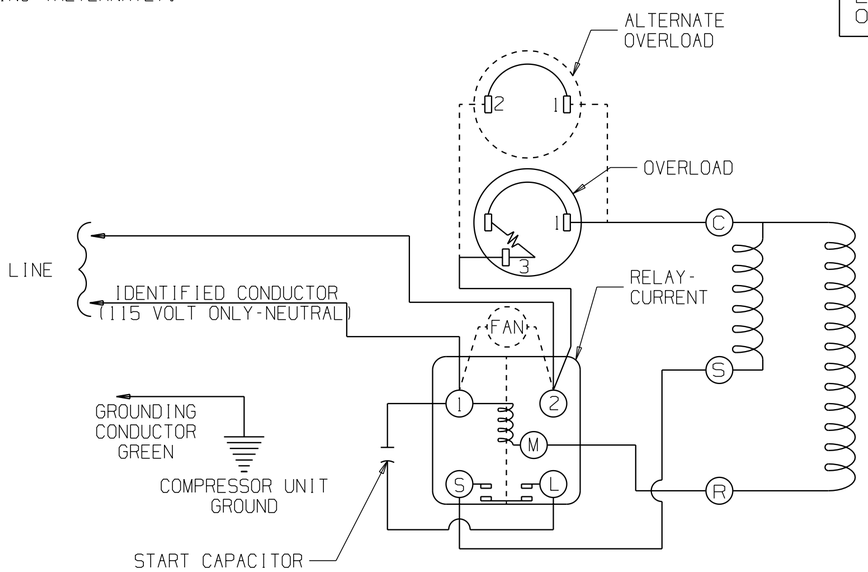

115 OR 230 VOLT-SCHEMATIC WIRING DIAGRAM -CSIR-CURRENT RELAY
(REF.DWG. MD472-9)

AK-115 OR 230 VOLT - CSIR - CURRENT RELAY

Q.A. SYMBOLS

AK

LT	LC	CHANGE	DATE
U	7E	EC19615 REVISE WIRE ROUTING	LOT 08JUL08
T	--	#231504-022 REVISED TO SHOW OVERLOAD HOLDER	HINMAN 07/30/97
S	--	REDRAWN NO CHANGE	--

THIS DRAWING OR PRINT (I) IS THE PROPERTY OF TECUMSEH PRODUCTS COMPANY (TECUMSEH) AND CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION BELONGING TO TECUMSEH. (II) IS MADE AVAILABLE TO THE RECIPIENT ON THE EXPRESS AND SPECIFIC CONDITION THAT NEITHER IT NOR THE INFORMATION CONTAINED THEREON OR DISCLOSED THEREIN SHALL BE DISCLOSED OR MADE AVAILABLE TO OTHERS WITHOUT THE EXPRESS AND SPECIFIC WRITTEN CONSENT OF TECUMSEH AND THAT SUCH INFORMATION ONLY AS EXPRESSLY AND SPECIFICALLY APPROVED IN WRITING BY TECUMSEH AND NOT OTHERWISE. (III) SHALL NOT BE COPIED OR DUPLICATED IN ANY MANNER OR TO ANY EXTENT WITHOUT TECUMSEH'S PRIOR EXPRESS AND SPECIFIC WRITTEN CONSENT AND (IV) SHALL BE RETURNED BY THE RECIPIENT THEREOF TO TECUMSEH AT THE LATTER'S REQUEST PROMPTLY AFTER SUCH REQUEST IS MADE.

DIS.CODE

NAME: ELECTRICAL HOOK-UP

SCALE: 1" = 1"

THIS PRINT SUPERSEDES ALL PRINTS PRIOR TO

TECUMSEH PRODUCTS CO.
TECUMSEH, MICHIGAN

MATERIAL

PART NO. DEAK2

INTERNAL USE ONLY
UG11DISK5:[HINMAN]AK-DEAK02_T-C.PRT

DO NOT SCALE THIS DRAWING. ALL FERROUS MATERIALS MUST NOT BE MAGNETIZED AS RECEIVED OR AT COMPRESSOR ASSEMBLY.