PART NO.
DEAK2




ELECTRICAL HOOK-UP
REF. DEAK1

--NOTES--

1. ASSEMBLE PARTS ASH SHOWN IS SPECIFIED ON B/M.
2. IDENTIFIED CONDUCTOR MAYBE WHITE OR RIBBED (115 VOLT ONLY - NEUTRAL).
3. SCREW TERM. RELAY REQUIRED WHEN RELAY IS MOUNTED IN ELECT. BOX 90991. SPADE TERM. RELAY FOR REMOTE MOUNTING (ALTERNATE).

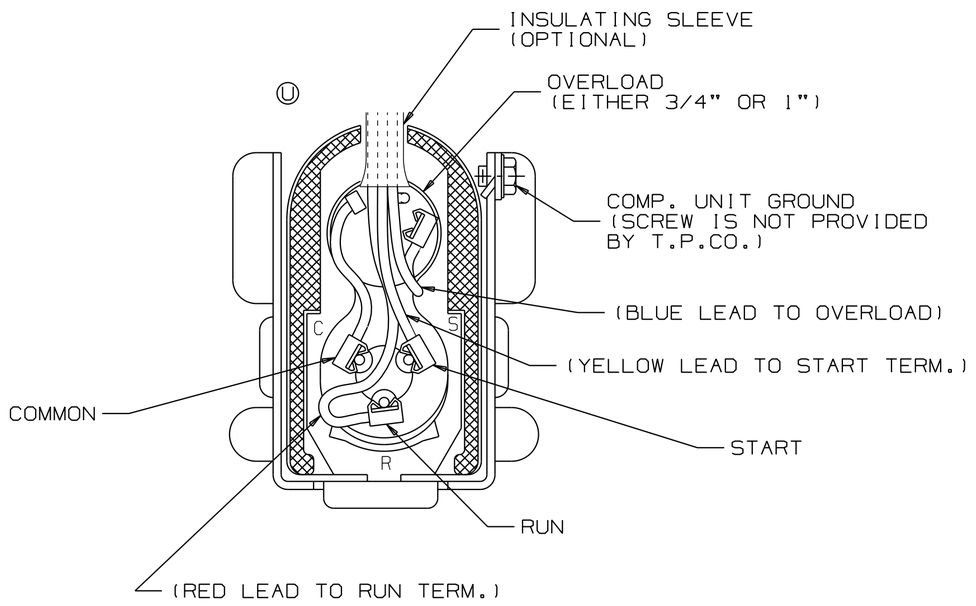


115 OR 230 VOLT-SCHEMATIC WIRING DIAGRAM -CSIR-
CURRENT RELAY
(REF.DWG. MD472-9)

WARNING-WIRING DIAGRAM MUST BE FOLLOWED AS SHOWN. ANY MISWIRING CAN CAUSE SERIOUS ELECTRICAL HAZARD AND POTENTIAL DAMAGE OR RUPTURE OF COMPONENT ELECTRICAL PARTS.

AK-115 OR 230 VOLT - CSIR - CURRENT RELAY

Q.A. SYMBOLS
AK
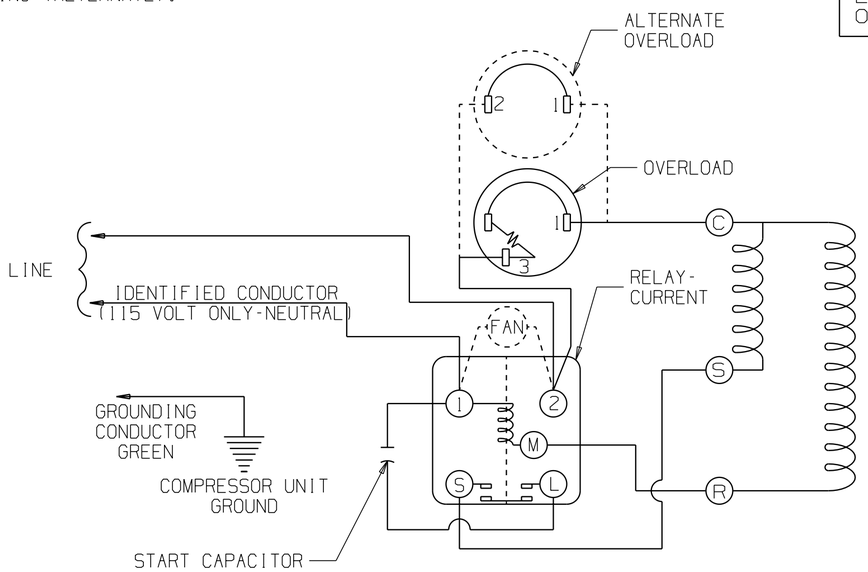
| LT | LC | CHANGE | DATE |
|---|---|---|---|
| | U | ECI9615 REVISE WIRE ROUTING | LOT 08JUL08 |
| | T | #231504-022 REVISED TO SHOW OVERLOAD HOLDER | HINMAN 07/30/97 |
| | S | REDRAWN NO CHANGE | -- |

THIS DRAWING OR PRINT (1) IS THE PROPERTY OF TECUMSEH PRODUCTS COMPANY AND CONTAINS CERTAIN PROPRIETARY AND CONFIDENTIAL INFORMATION OWNED BY TECUMSEH. (2) THIS MADE AVAILABLE TO THE RECIPIENT ON THE EXPRESS AND CONDITION THAT THE RECIPIENT WILL NOT THE INFORMATION CONTAINED HEREIN OR DISCLOSED OR MADE AVAILABLE TO OTHERS WITHOUT THE EXPRESS AND WRITTEN CONSENT OF TECUMSEH AND THAT SUCH INFORMATION APPROVED FOR WRITING BY TECUMSEH IN WRITING BY TECUMSEH. (3) THIS DRAWING OR PRINT SHALL NOT AND NOT OTHERWISE, (III) SHALL NOT MANNER OR TO ANY EXTENT WITHOUT SPECIFIC WRITTEN CONSENT AND (IV) SHALL BE RETURNED BY THE RECIPIENT LATTER'S REQUEST PROMPTLY AFTER SUCH REQUEST IS MADE.

| DIS.CODE | NAME |
|---|---|
| | ELECTRICAL HOOK-UP |

DO NOT SCALE THIS DRAWING ALL DIMENSIONS MATERIALS MUST NOT BE MAGNETIZED AS REQUIRED FOR A COMPRESSOR ASSEMBLY

SCALE 1" = 1"

THIS PRINT SUPERSEDES ALL PRINTS PRIOR TO

TECUMSEH PRODUCTS CO.
TECUMSEH, MICHIGAN

MATERIAL

PART NO. DEAK2

INTERNAL USE ONLY
UG\IDISK5:[HINMAN]AK-DEAK02_T-C.PRT