


ELECTRICAL HOOK-UP
 REF. DEAK1

--NOTES--

1. ASSEMBLE PARTS ASH SHOWN IS SPECIFIED ON B/M.
2. IDENTIFIED CONDUCTOR MAYBE WHITE OR RIBBED (115 VOLT ONLY - NEUTRAL).
3. SCREW TERM. RELAY REQUIRED WHEN RELAY IS MOUNTED IN ELECT. BOX 90991. SPADE TERM. RELAY FOR REMOTE MOUNTING (ALTERNATE).

WARNING-WIRING DIAGRAM MUST BE FOLLOWED AS SHOWN. ANY MISWIRING CAN CAUSE SERIOUS ELECTRICAL HAZARD AND POTENTIAL DAMAGE OR RUPTURE OF COMPONENT ELECTRICAL PARTS.

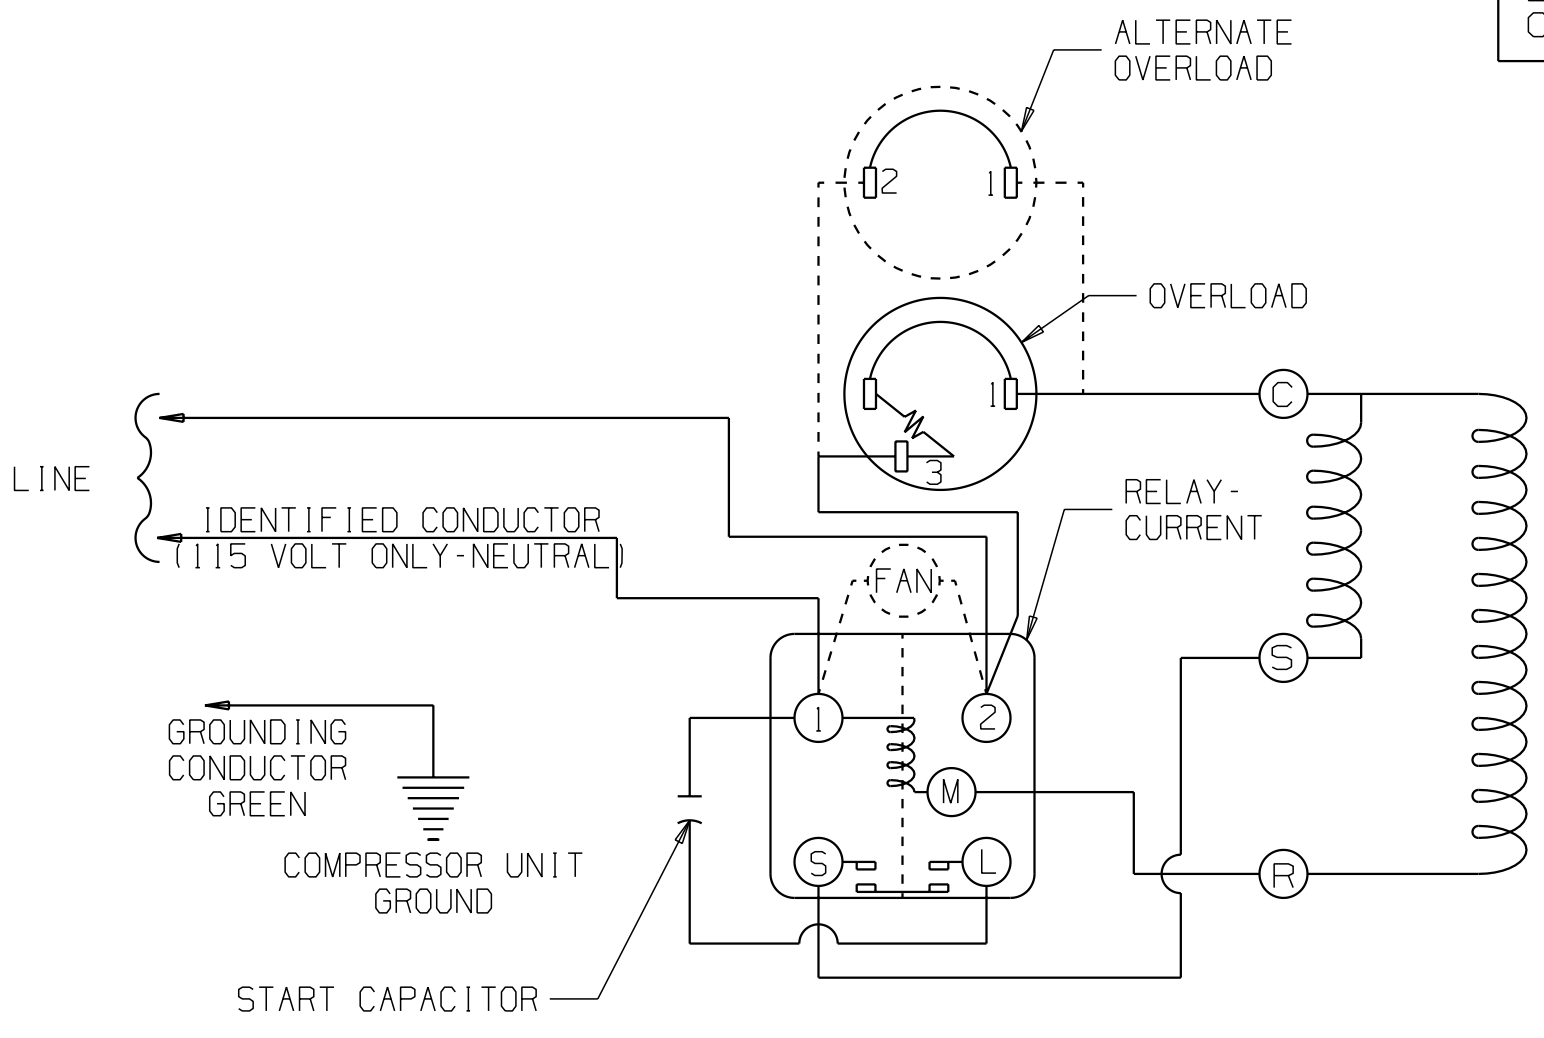

AK-115 OR 230 VOLT - CSIR - CURRENT RELAY

115 OR 230 VOLT-SCHEMATIC WIRING DIAGRAM -CSIR-
 CURRENT RELAY
 (REF.DWG. MD472-9)

Q.A. SYMBOLS

AK

EC19615	LOT	DATE	ELECTRICAL HOOK-UP	
REVISION	OBJ	CHANGE	SCALE	THIS PRINT SUPERSEDES ALL PRINTS PRIOR TO
7E	77	NO CHANGE	1" = 1"	PART NO.
U	T	S	DEAK2	
MATERIAL INTERNAL USE ONLY UG11D1SK5:1 H1NMAN JAK-DEAK02_T-C.PRT				

THIS DRAWING OR PRINT IS THE PROPERTY OF TECUMSEH PRODUCTS COMPANY. IT IS LOANED TO YOU FOR YOUR INFORMATION ONLY AND IS NOT TO BE REPRODUCED, COPIED, OR TRANSMITTED IN ANY MANNER WITHOUT THE WRITTEN CONSENT OF TECUMSEH PRODUCTS COMPANY. ANY INFORMATION CONTAINED HEREIN IS UNCLASSIFIED AND IS NOT TO BE RELEASED TO THE PUBLIC OR TO ANY OTHER PARTY WITHOUT THE WRITTEN CONSENT OF TECUMSEH PRODUCTS COMPANY. ANY INFORMATION CONTAINED HEREIN IS UNCLASSIFIED AND IS NOT TO BE RELEASED TO THE PUBLIC OR TO ANY OTHER PARTY WITHOUT THE WRITTEN CONSENT OF TECUMSEH PRODUCTS COMPANY.