


ELECTRICAL HOOK-UP
REF. DEAK1

--NOTES--

1. ASSEMBLE PARTS ASH SHOWN IS SPECIFIED ON B/M.
2. IDENTIFIED CONDUCTOR MAYBE WHITE OR RIBBED (115 VOLT ONLY - NEUTRAL).
3. SCREW TERM. RELAY REQUIRED WHEN RELAY IS MOUNTED IN ELECT. BOX 90991. SPADE TERM. RELAY FOR REMOTE MOUNTING (ALTERNATE).

WARNING-WIRING DIAGRAM MUST BE FOLLOWED AS SHOWN. ANY MISWIRING CAN CAUSE SERIOUS ELECTRICAL HAZARD AND POTENTIAL DAMAGE OR RUPTURE OF COMPONENT ELECTRICAL PARTS.

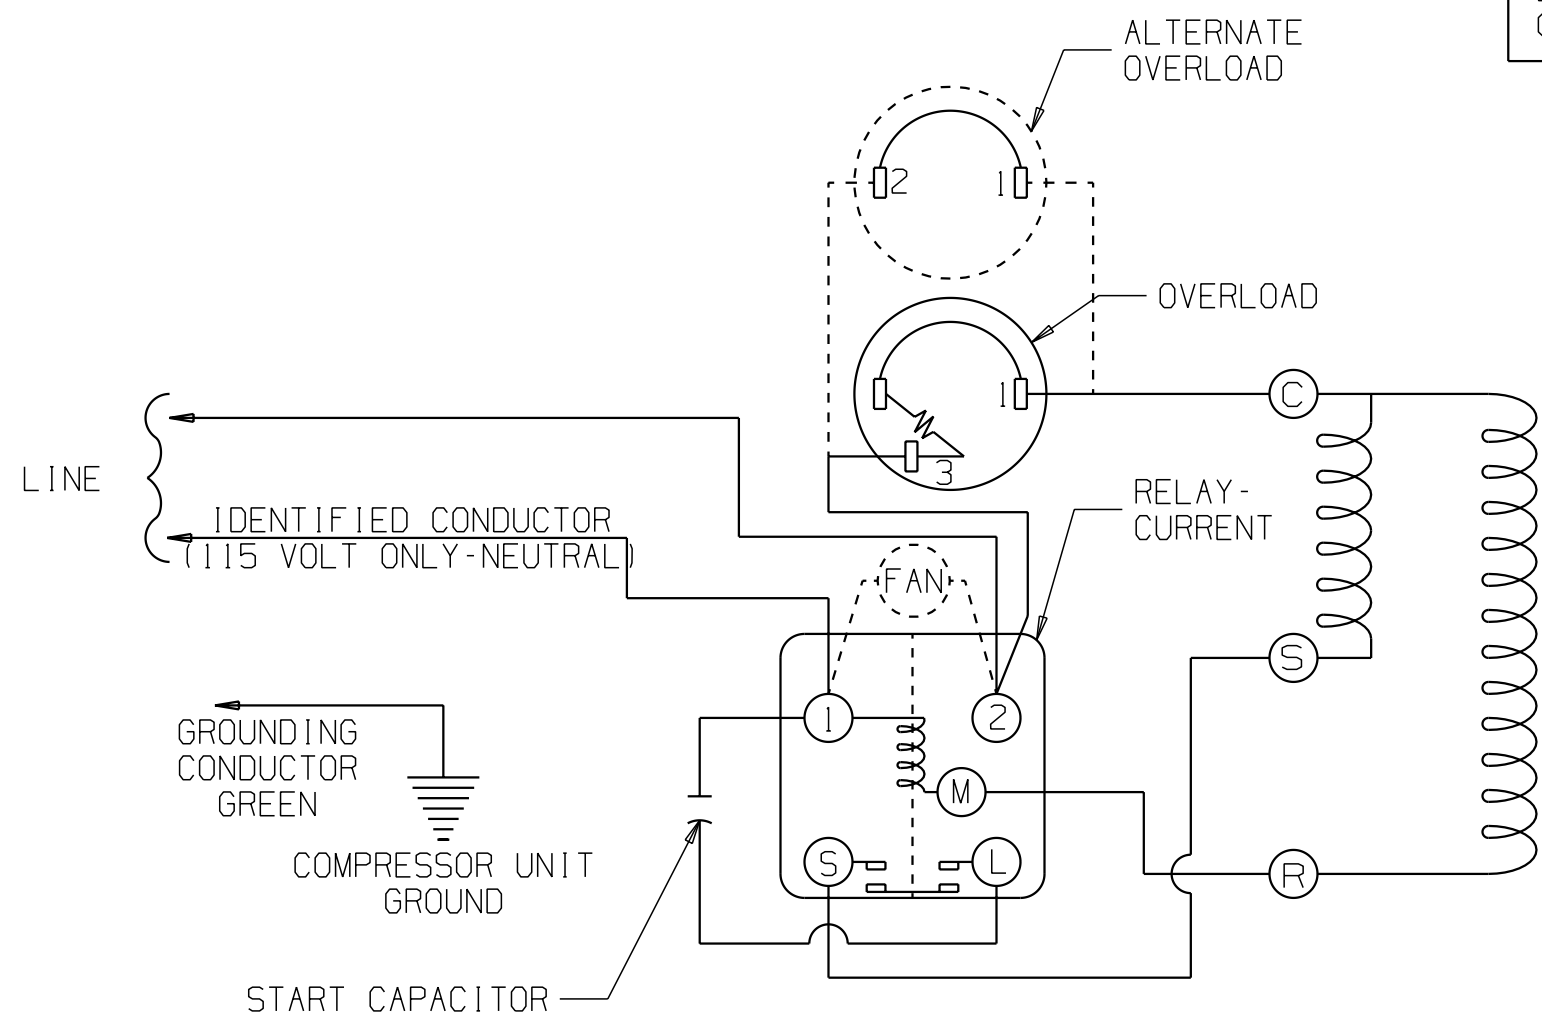

115 OR 230 VOLT-SCHEMATIC WIRING DIAGRAM -CSIR-
CURRENT RELAY
(REF.DWG. MD472-9)

AK-115 OR 230 VOLT - CSIR - CURRENT RELAY

Q.A. SYMBOLS

AK

| | | | | | | | | | | | |
|---|----|-----------------------------------------------------|----------------|------------------|-----------|------|------|----------|------------------------------------------------------------|---------|----------------------------------------------|
| U | 7E | EC19615 REVISE WIRE ROUTING | LOT 08JUL08 | HINMAN 7/30/9 | NO CHANGE | DATE | DATE | DIS.CODE | NAME | SCALE | THIS PRINT SUPERSEDES ALL PRINTS PRIOR TO |
| T | | 4231504-022 --REVISED TO SHOW OVERLOAD HOLDER | | | | | | | ELECTRICAL HOOK-UP | 1" = 1" | |
| S | | REDRAWN | | | | | | | TECUMSEH PRODUCTS CO. TECUMSEH, MICHIGAN | | PART NO. |
| | | | | | | | | | | | DEAK2 |
| | | | | | | | | | INTERNAL USE ONLY UG11D1SK5:1 HINMAN JAK-DEAK02_T-C.PRT | | |