


ELECTRICAL HOOK-UP  
REF. DEAK1

--NOTES--

1. ASSEMBLE PARTS ASH SHOWN IS SPECIFIED ON B/M.
2. IDENTIFIED CONDUCTOR MAYBE WHITE OR RIBBED (115 VOLT ONLY - NEUTRAL).
3. SCREW TERM. RELAY REQUIRED WHEN RELAY IS MOUNTED IN ELECT. BOX 90991. SPADE TERM. RELAY FOR REMOTE MOUNTING (ALTERNATE).

WARNING-WIRING DIAGRAM MUST BE FOLLOWED AS SHOWN. ANY MISWIRING CAN CAUSE SERIOUS ELECTRICAL HAZARD AND POTENTIAL DAMAGE OR RUPTURE OF COMPONENT ELECTRICAL PARTS.

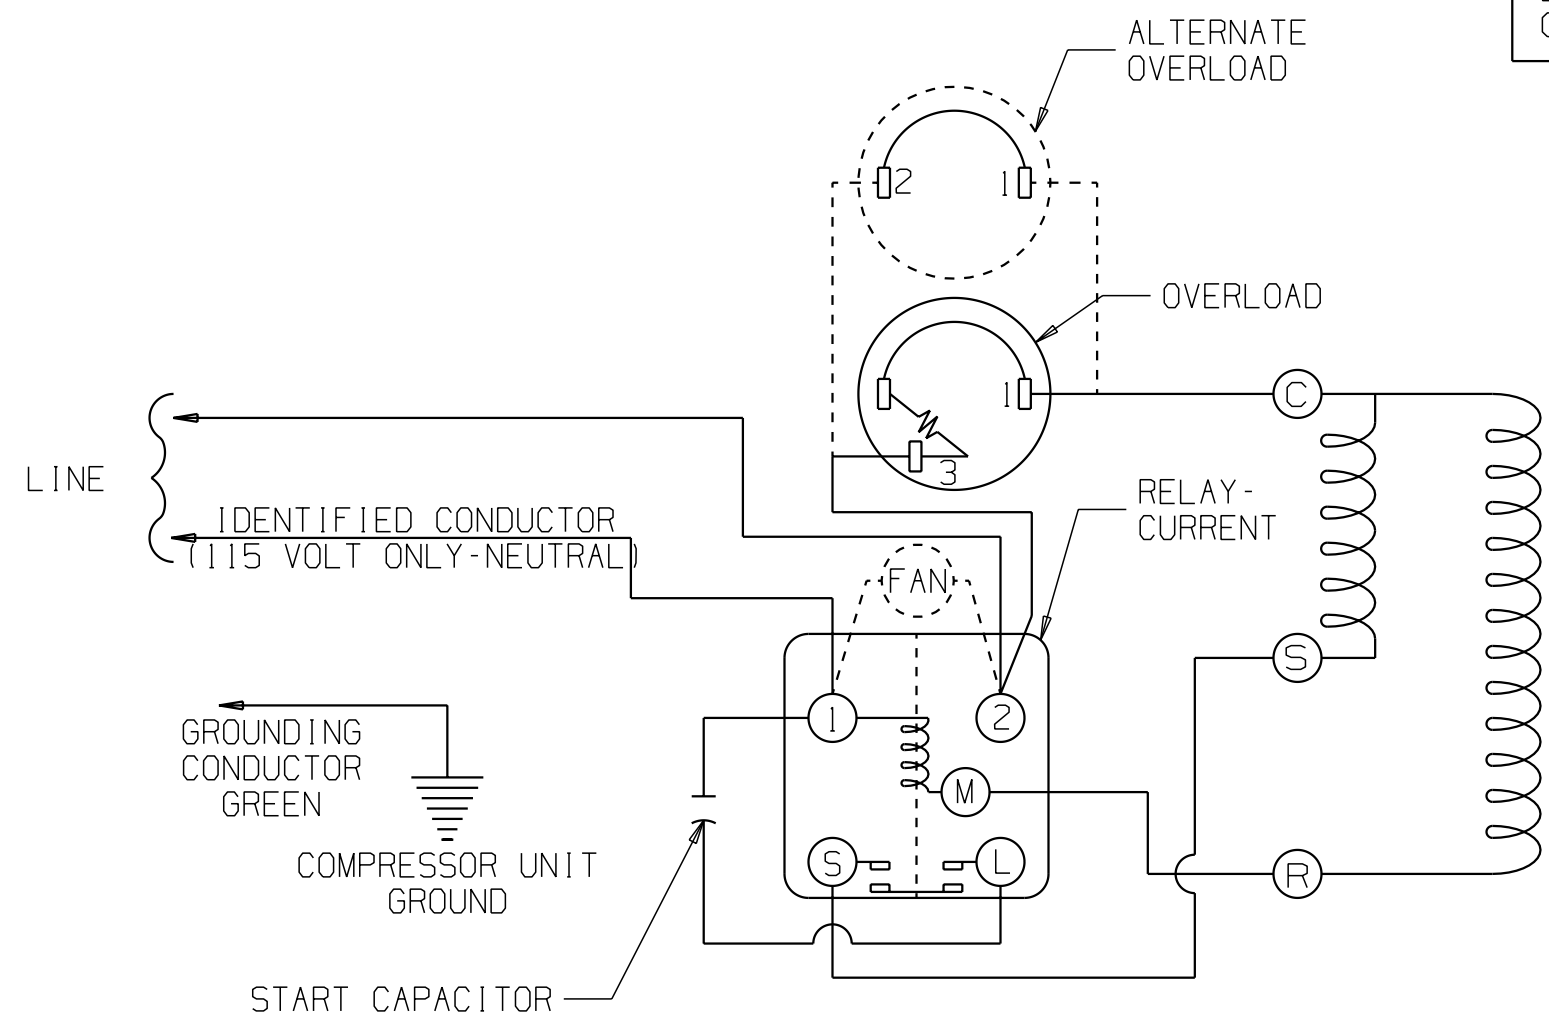

115 OR 230 VOLT-SCHEMATIC WIRING DIAGRAM -CSIR-  
CURRENT RELAY  
(REF.DWG. MD472-9)

AK-115 OR 230 VOLT - CSIR - CURRENT RELAY

Q.A. SYMBOLS

AK

U	7E	EC19615 REVISE WIRE ROUTING	LOT 08JUL08	DATE	NO CHANGE	REVISIONS	DATE	CHANGE	DATE	DIS. CODE	NAME	SCALE	THIS PRINT SUPERSEDES ALL PRINTS PRIOR TO
T		4231504-022 --REVISED TO SHOW OVERLOAD HOLDER	HINMAN 7/30/9								ELECTRICAL HOOK-UP	1" = 1"	
S		REDRAWN									TECUMSEH PRODUCTS CO. TECUMSEH, MICHIGAN		PART NO.
													DEAK2
INTERNAL USE ONLY UG11D1SK5:1 HINMAN JAK-DEAK02_T-C.PRT													