


ELECTRICAL HOOK-UP
REF. DEAK1

--NOTES--

1. ASSEMBLE PARTS ASH SHOWN IS SPECIFIED ON B/M.
2. IDENTIFIED CONDUCTOR MAYBE WHITE OR RIBBED (115 VOLT ONLY - NEUTRAL).
3. SCREW TERM. RELAY REQUIRED WHEN RELAY IS MOUNTED IN ELECT. BOX 90991. SPADE TERM. RELAY FOR REMOTE MOUNTING (ALTERNATE).

WARNING-WIRING DIAGRAM MUST BE FOLLOWED AS SHOWN. ANY MISWIRING CAN CAUSE SERIOUS ELECTRICAL HAZARD AND POTENTIAL DAMAGE OR RUPTURE OF COMPONENT ELECTRICAL PARTS.

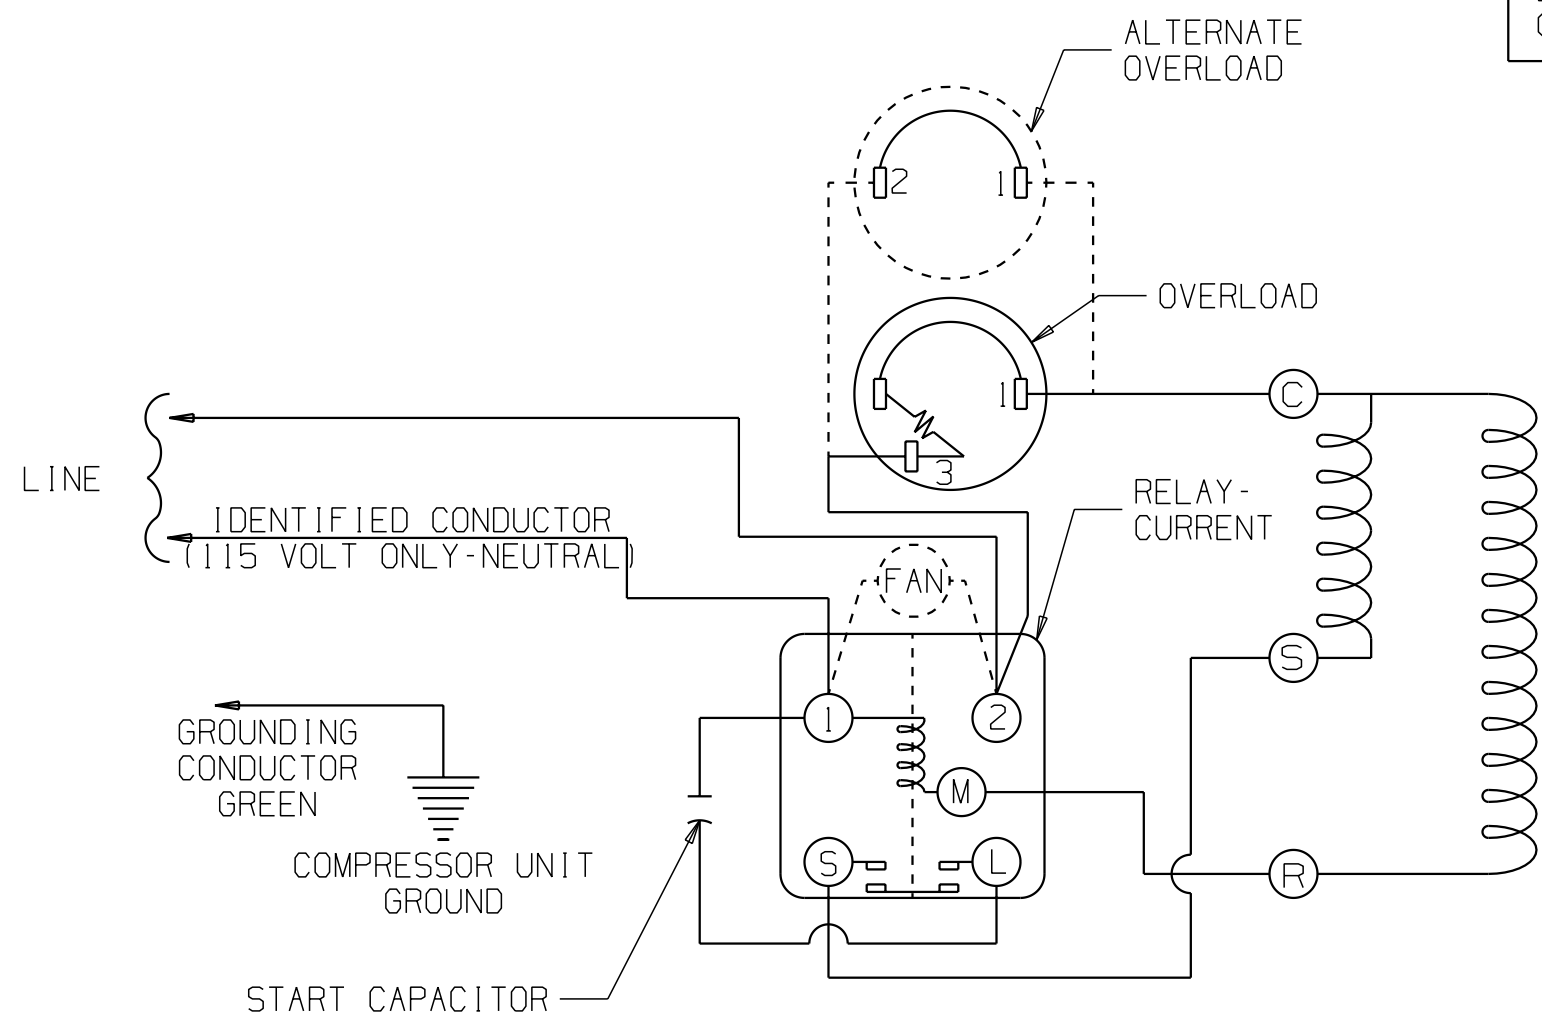

115 OR 230 VOLT-SCHEMATIC WIRING DIAGRAM -CSIR-
CURRENT RELAY
(REF.DWG. MD472-9)

Q.A. SYMBOLS

AK

AK-115 OR 230 VOLT - CSIR - CURRENT RELAY

U	7E	EC19615 REVISE WIRE ROUTING	LOT 08JUL08	DATE --	CHANGE --	LT S	LC T	DATE 7/30/97	REVISION HINMAN OVERLOAD HOLDER	4231504-022	DIS.CODE	NAME ELECTRICAL HOOK-UP	SCALE 1" = 1"	THIS PRINT SUPERSEDES ALL PRINTS PRIOR TO
<p>THIS DRAWING OR PRINT IS THE PROPERTY OF TECUMSEH PRODUCTS COMPANY AND IS NOT TO BE REPRODUCED, COPIED, OR TRANSMITTED IN ANY MANNER WITHOUT THE WRITTEN CONSENT OF TECUMSEH PRODUCTS COMPANY. THE INFORMATION CONTAINED HEREIN IS UNCLASSIFIED AND IS NOT TO BE RELEASED TO THE PUBLIC IN ANY MANNER OR TO ANY EXTENT WITHOUT THE WRITTEN CONSENT OF TECUMSEH PRODUCTS COMPANY. IF YOU ARE A GOVERNMENT AGENCY AND HAVE RECEIVED THIS DRAWING OR PRINT FROM TECUMSEH PRODUCTS COMPANY, YOU ARE NOT TO RELEASE IT TO THE PUBLIC IN ANY MANNER OR TO ANY EXTENT WITHOUT THE WRITTEN CONSENT OF TECUMSEH PRODUCTS COMPANY. IF YOU ARE A GOVERNMENT AGENCY AND HAVE RECEIVED THIS DRAWING OR PRINT FROM TECUMSEH PRODUCTS COMPANY, YOU ARE NOT TO RELEASE IT TO THE PUBLIC IN ANY MANNER OR TO ANY EXTENT WITHOUT THE WRITTEN CONSENT OF TECUMSEH PRODUCTS COMPANY.</p>														
<p>INTERNAL USE ONLY UG11D1SK5:1 HINMAN JAK-DEAK02_T-C.PRT</p>														
<p>TECUMSEH PRODUCTS CO. TECUMSEH, MICHIGAN</p>														
<p>PART NO. DEAK2</p>														