


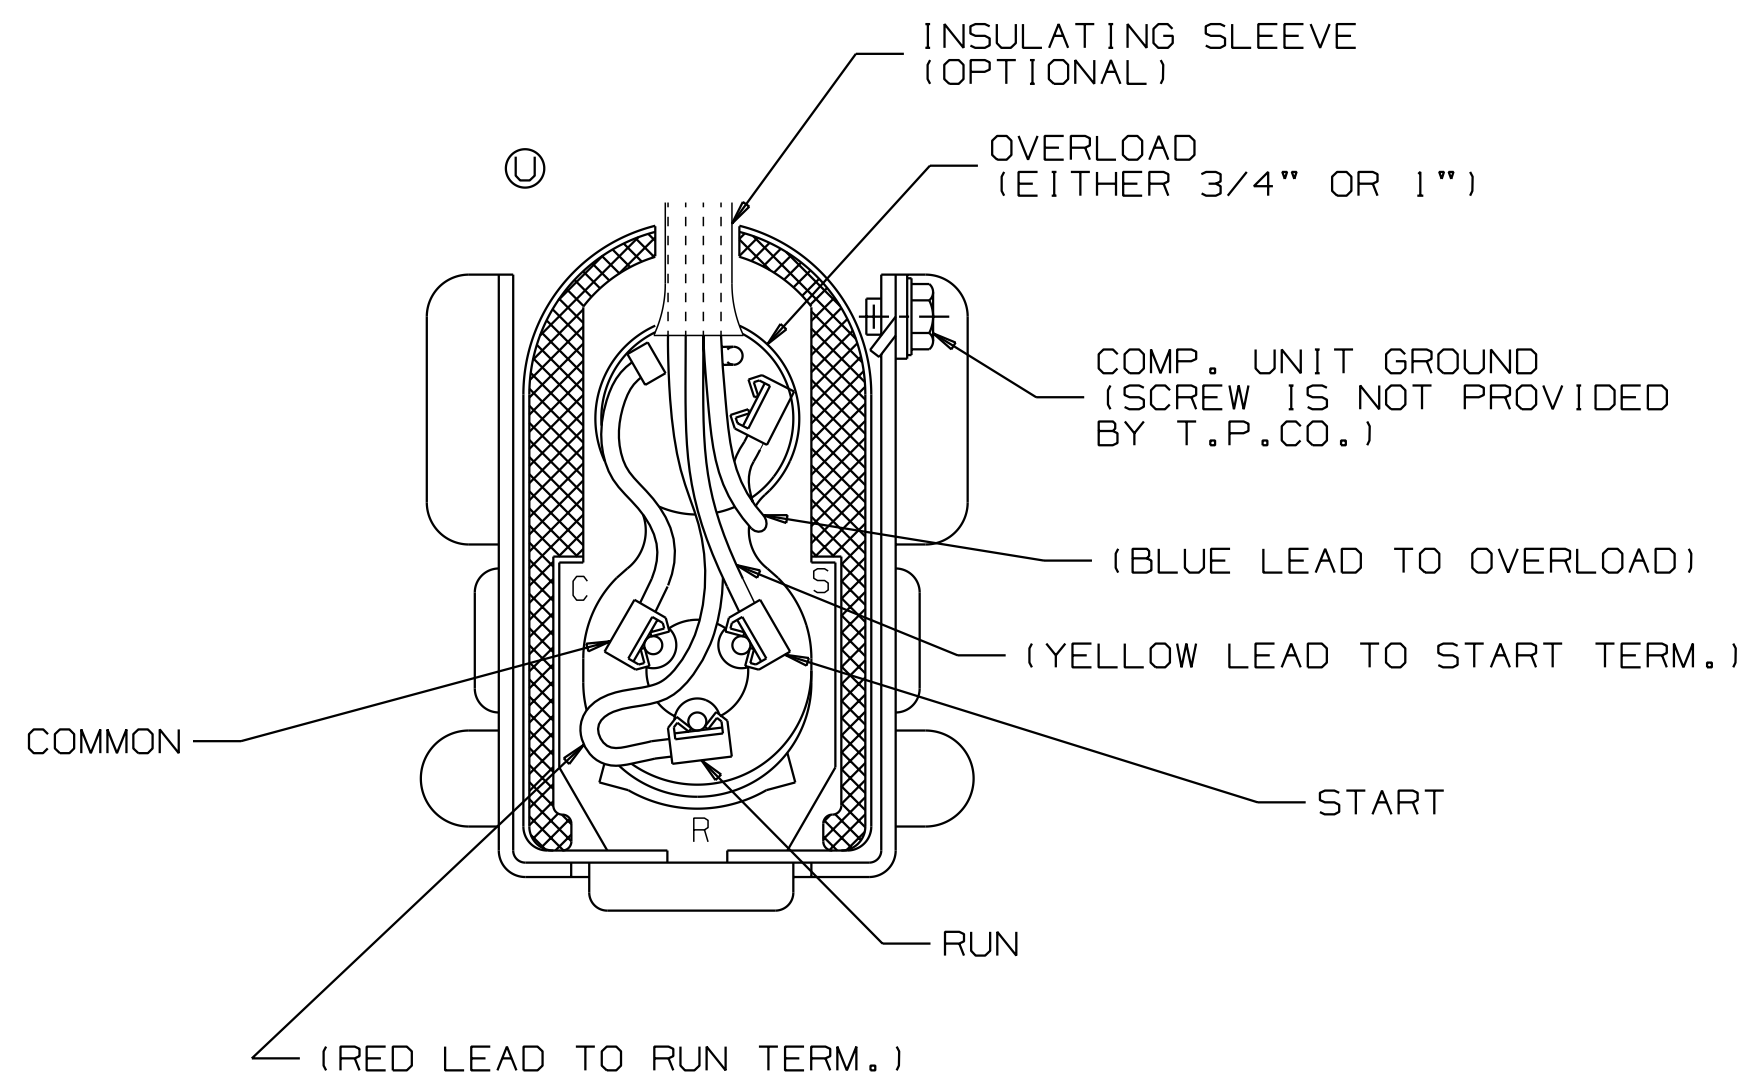


ELECTRICAL HOOK-UP
REF. DEAK1

--NOTES--

1. ASSEMBLE PARTS ASH SHOWN IS SPECIFIED ON B/M.
2. IDENTIFIED CONDUCTOR MAYBE WHITE OR RIBBED (115 VOLT ONLY - NEUTRAL).
3. SCREW TERM. RELAY REQUIRED WHEN RELAY IS MOUNTED IN ELECT. BOX 90991. SPADE TERM. RELAY FOR REMOTE MOUNTING (ALTERNATE).

WARNING-WIRING DIAGRAM MUST BE FOLLOWED
AS SHOWN. ANY MISWIRING CAN CAUSE SERIOUS
ELECTRICAL HAZARD AND POTENTIAL DAMAGE
OR RUPTURE OF COMPONENT ELECTRICAL PARTS.

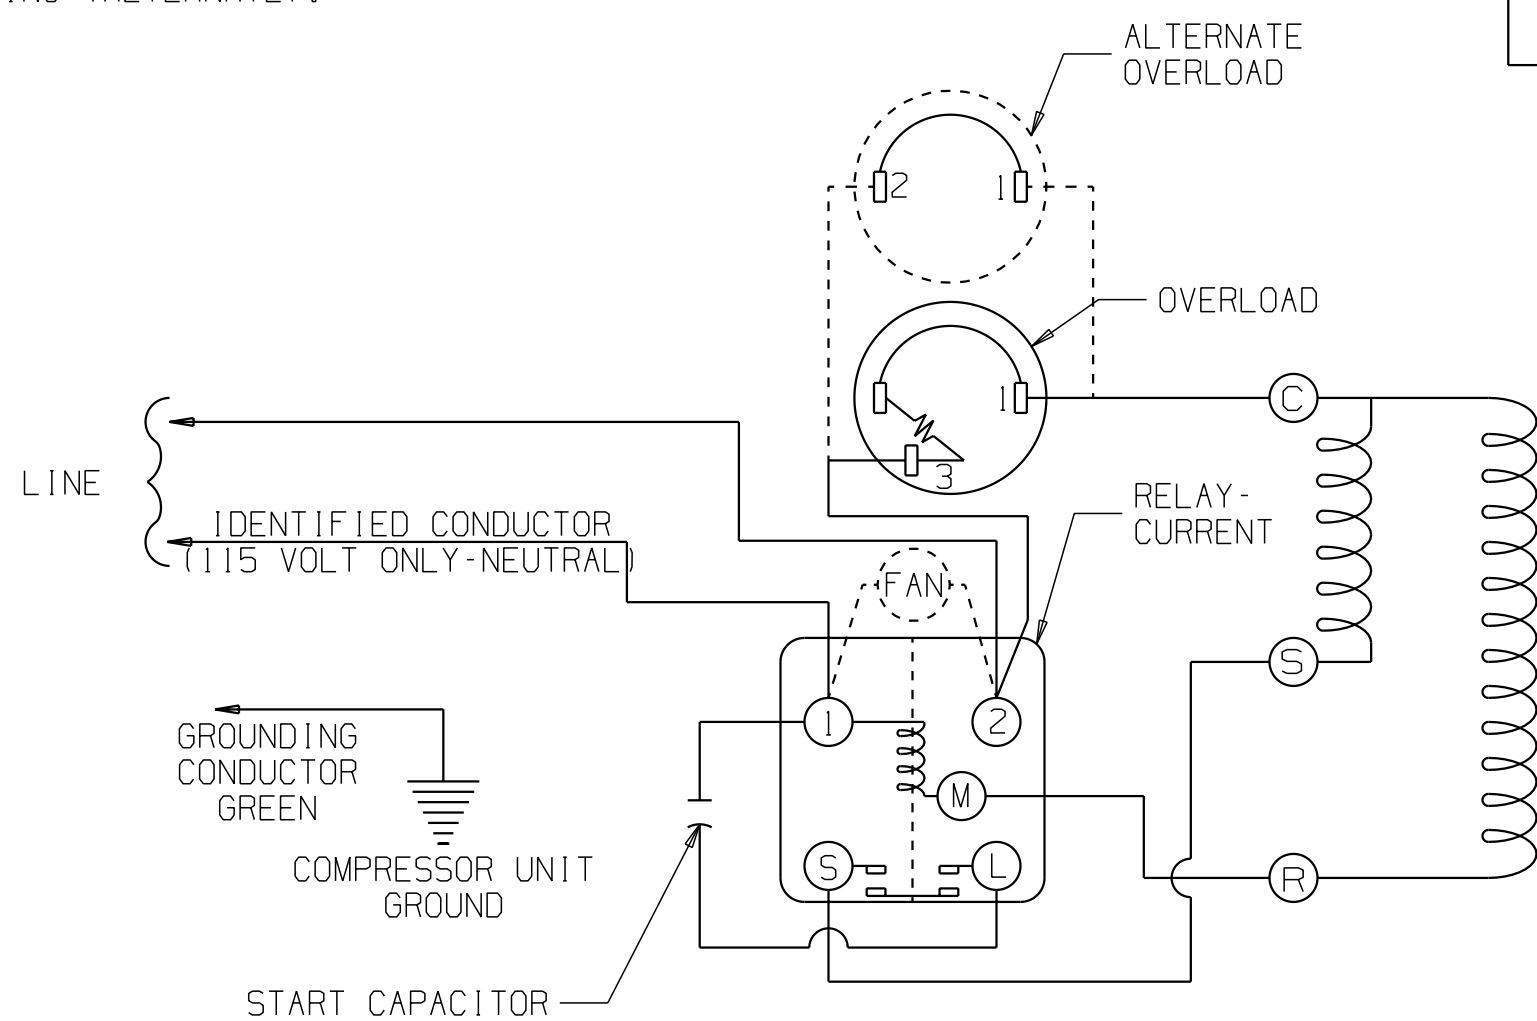

AK-115 OR 230 VOLT - CSIR - CURRENT RELAY

Q.A. SYMBOLS

AK

115 OR 230 VOLT-SCHEMATIC WIRING DIAGRAM -CSIR-
CURRENT RELAY
(REF.DWG. MD472-9)

ELECTRICAL HOOK-UP

TECUMSEH PRODUCTS CO.
TECUMSEH, MICHIGAN

MATERIAL

INTERNAL USE ONLY
UG11D1SK511 HINMAN JAK-DEAK02_T-C.PRT

PART NO.

DEAK2

THIS DRAWING OR PRINT (1) IS THE PROPERTY OF TECUMSEH PRODUCTS COMPANY AND IS LOANED TO THE RECIPIENT ON THE EXPRESS AND EXCLUSIVE UNDERSTANDING THAT IT IS TO BE USED FOR THE INFORMATION CONTAINED HEREIN ONLY. IT IS NOT TO BE REPRODUCED, COPIED, OR OTHERWISE DISSEMINATED TO ANY OTHERS WITHOUT THE EXPRESS AND WRITTEN CONSENT OF TECUMSEH, AND THAT SUCH INFORMATION IS NOT TO BE USED FOR ANY PURPOSES OTHER THAN THAT SPECIFICALLY APPROVED IN WRITING BY TECUMSEH. ANY VIOLATION OF THESE TERMS SHALL BE CAUSE FOR IMMEDIATE CANCELLATION OF THE LOAN AND THE RETURN OF THE DRAWING OR PRINT TO TECUMSEH. THE RECIPIENT SHALL BE RESPONSIBLE FOR THE PROTECTION OF THIS INFORMATION AND SHALL BE PROMPTLY PROMPTLY AFTER SUCH REQUEST IS MADE.

DO NOT SCALE
DRAWING ALL FERROUS
MATERIALS MUST NOT
BE MOUNTED AS
RECOMMENDED AS
COMPRESSOR ASSEMBLY.

DIS.CODE NAME

SCALE
1" = 1"

THIS PRINT SUPERSEDES ALL PRINTS PRIOR TO

PART NO.

DATE

CHANGE

LT LC

NO CHANGE

REDAWN

REVIS

ROUTING

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS

REVIS