


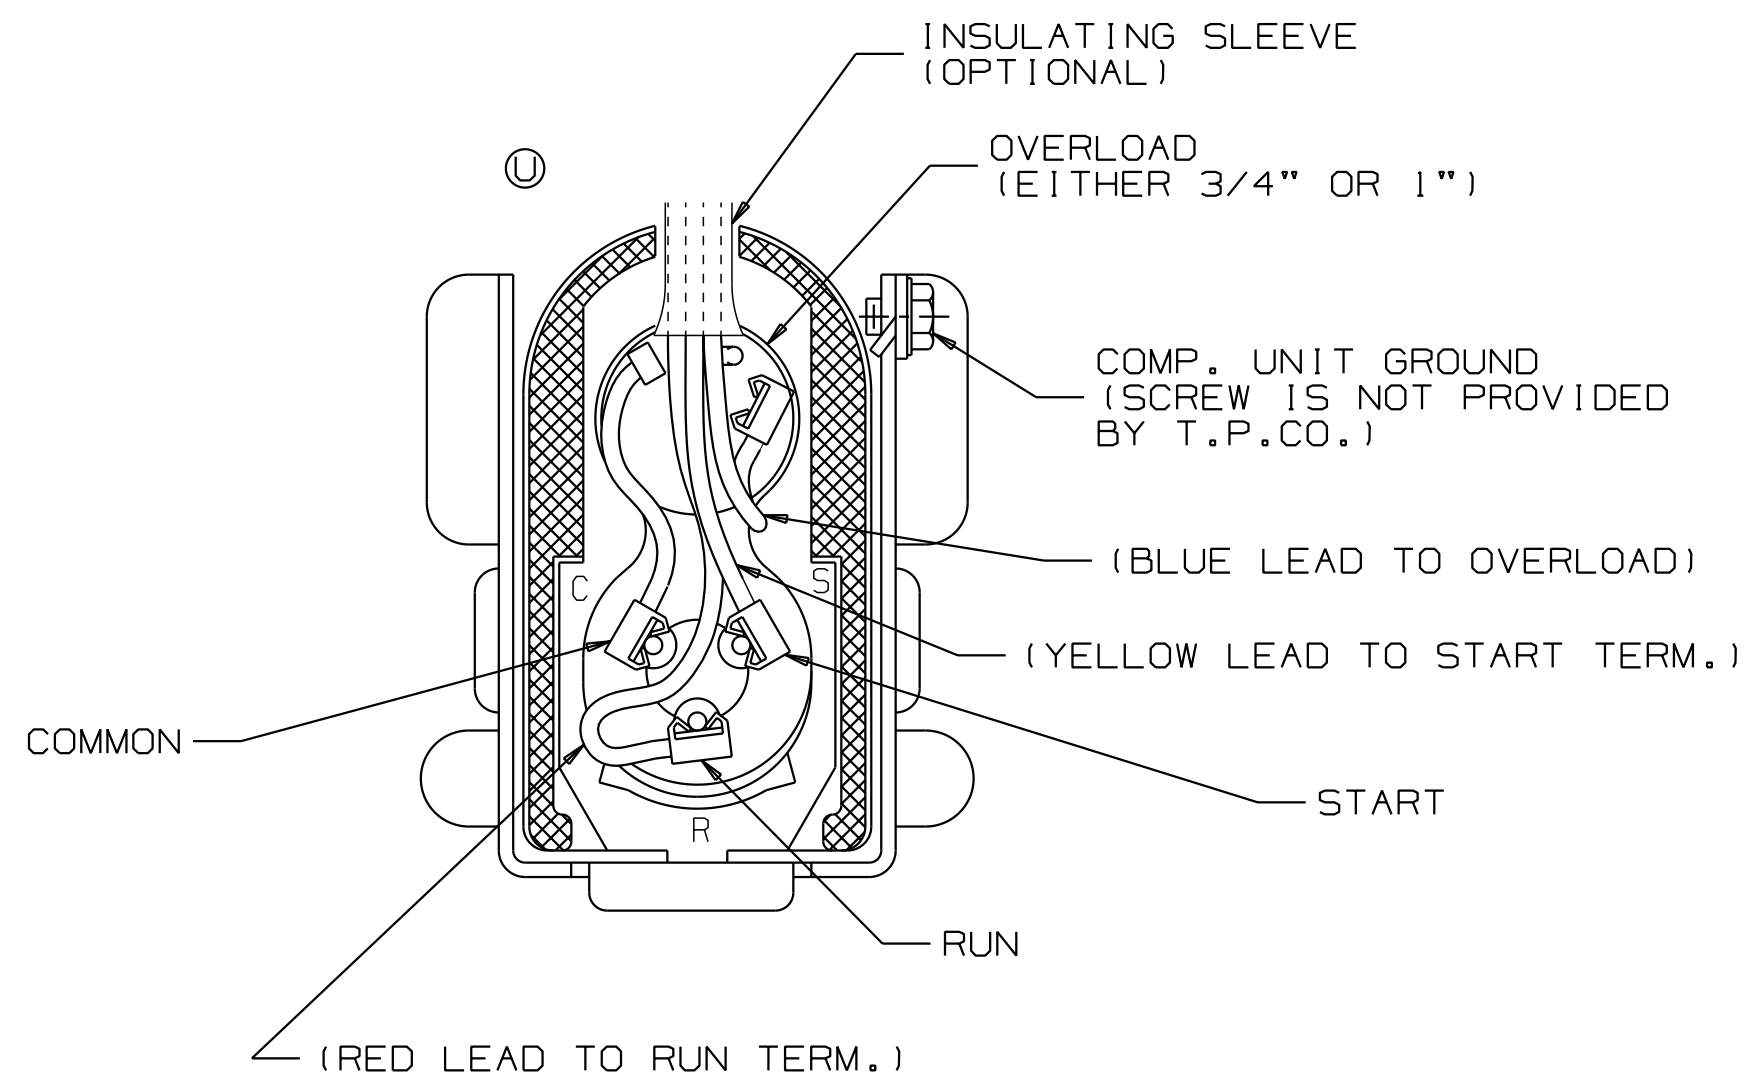


ELECTRICAL HOOK-UP
REF. DEAK1

--NOTES--

1. ASSEMBLE PARTS AS SHOWN IS SPECIFIED ON B/M.
2. IDENTIFIED CONDUCTOR MAYBE WHITE OR RIBBED (115 VOLT ONLY - NEUTRAL).
3. SCREW TERM. RELAY REQUIRED WHEN RELAY IS MOUNTED IN ELECT. BOX 90991. SPADE TERM. RELAY FOR REMOTE MOUNTING (ALTERNATE).

WARNING-WIRING DIAGRAM MUST BE FOLLOWED
AS SHOWN. ANY MISWIRING CAN CAUSE SERIOUS
ELECTRICAL HAZARD AND POTENTIAL DAMAGE
OR RUPTURE OF COMPONENT ELECTRICAL PARTS.

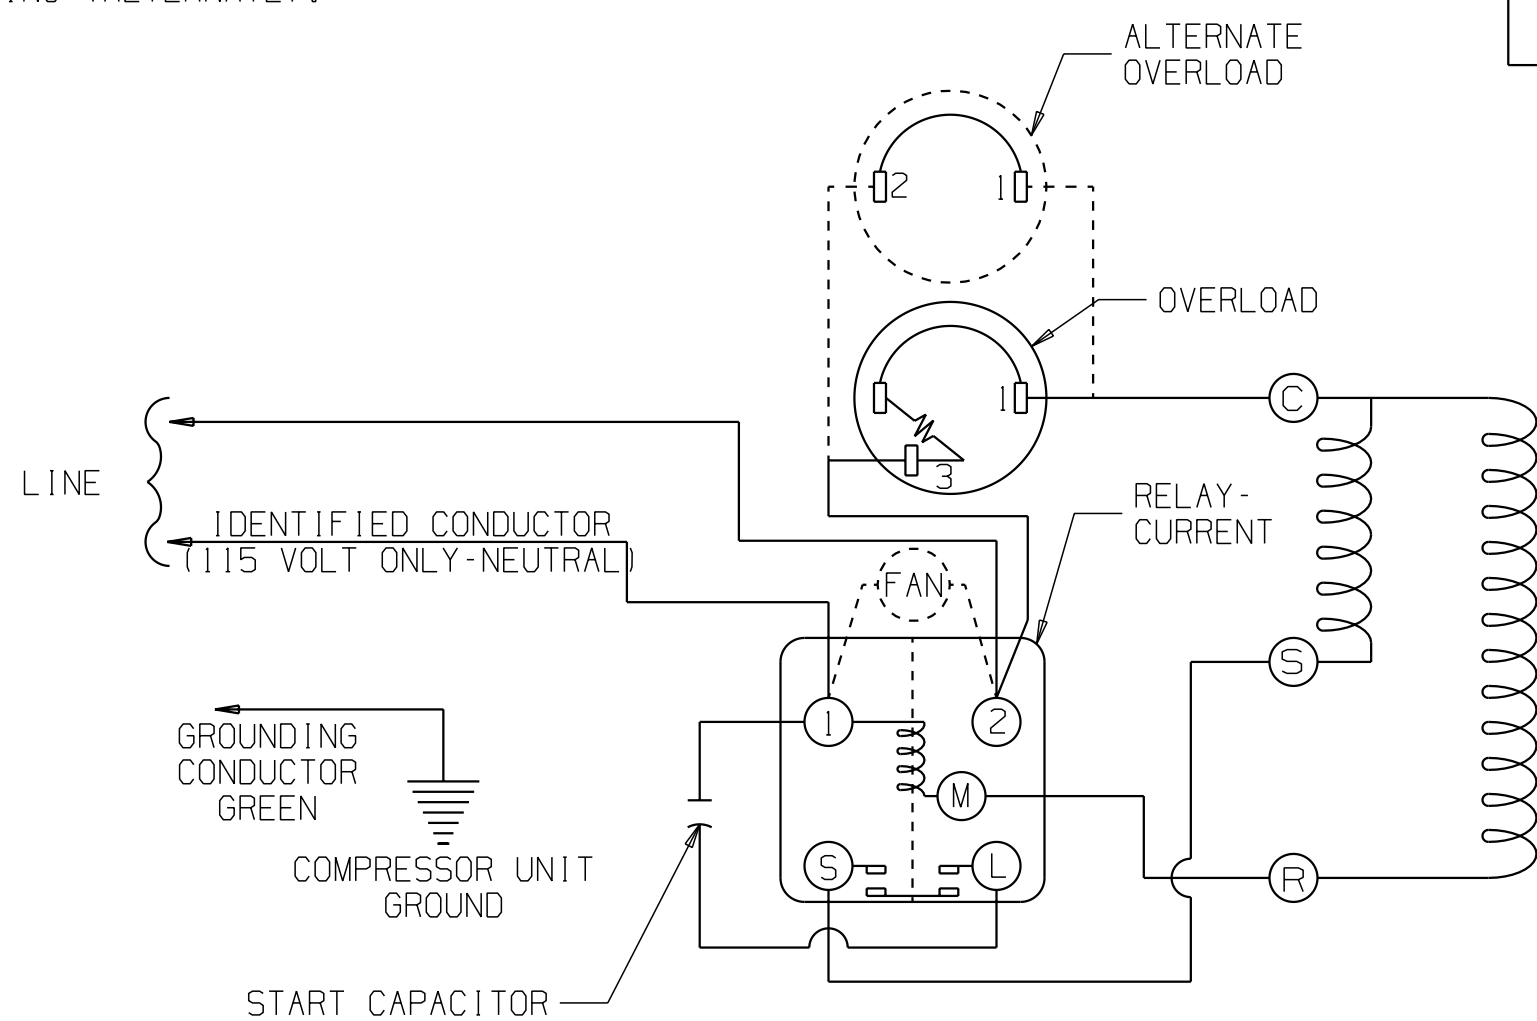

115 OR 230 VOLT-SCHEMATIC WIRING DIAGRAM -CSIR-
CURRENT RELAY
(REF.DWG. MD472-9)

AK-115 OR 230 VOLT - CSIR - CURRENT RELAY

Q.A. SYMBOLS

AK

DIS.CODE	NAME	SCALE	THIS PRINT SUPERSEDES ALL PRINTS PRIOR TO
	ELECTRICAL HOOK-UP	1" = 1"	
	TECUMSEH PRODUCTS CO. TECUMSEH, MICHIGAN		PART NO.
	MATERIAL		DEAK2
	INTERNAL USE ONLY UG11D1SK5:H1HINMAN JAK-DEAK02_T-C.PRT		