


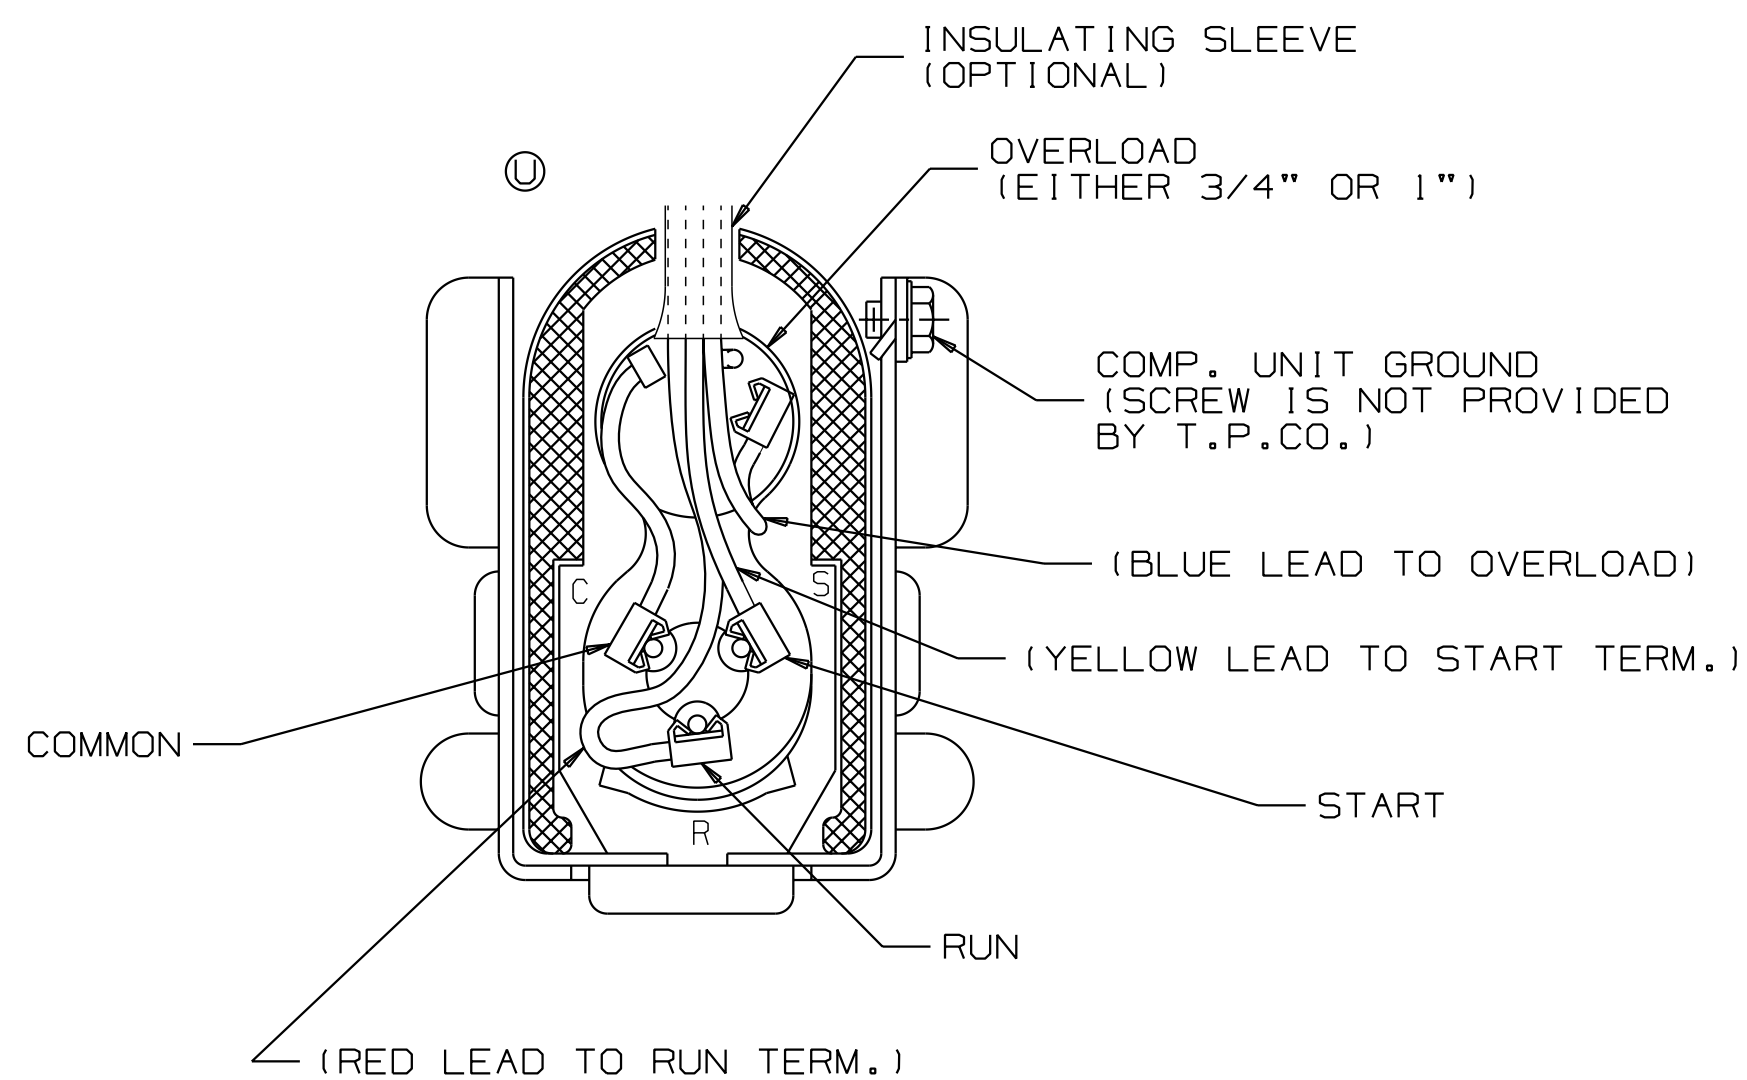


ELECTRICAL HOOK - UP
REF. DEAK 1

- - NOTES - -

1. ASSEMBLE PARTS ASH SHOWN IS SPECIFIED ON B/M.
2. IDENTIFIED CONDUCTOR MAYBE WHITE OR RIBBED (115 VOLT ONLY - NEUTRAL).
3. SCREW TERM. RELAY REQUIRED WHEN RELAY IS MOUNTED IN ELECT. BOX 90991. SPADE TERM. RELAY FOR REMOTE MOUNTING (ALTERNATE).

WARNING-WIRING DIAGRAM MUST BE FOLLOWED
AS SHOWN. ANY MISWIRING CAN CAUSE SERIOUS
ELECTRICAL HAZARD AND POTENTIAL DAMAGE
OR RUPTURE OF COMPONENT ELECTRICAL PARTS.

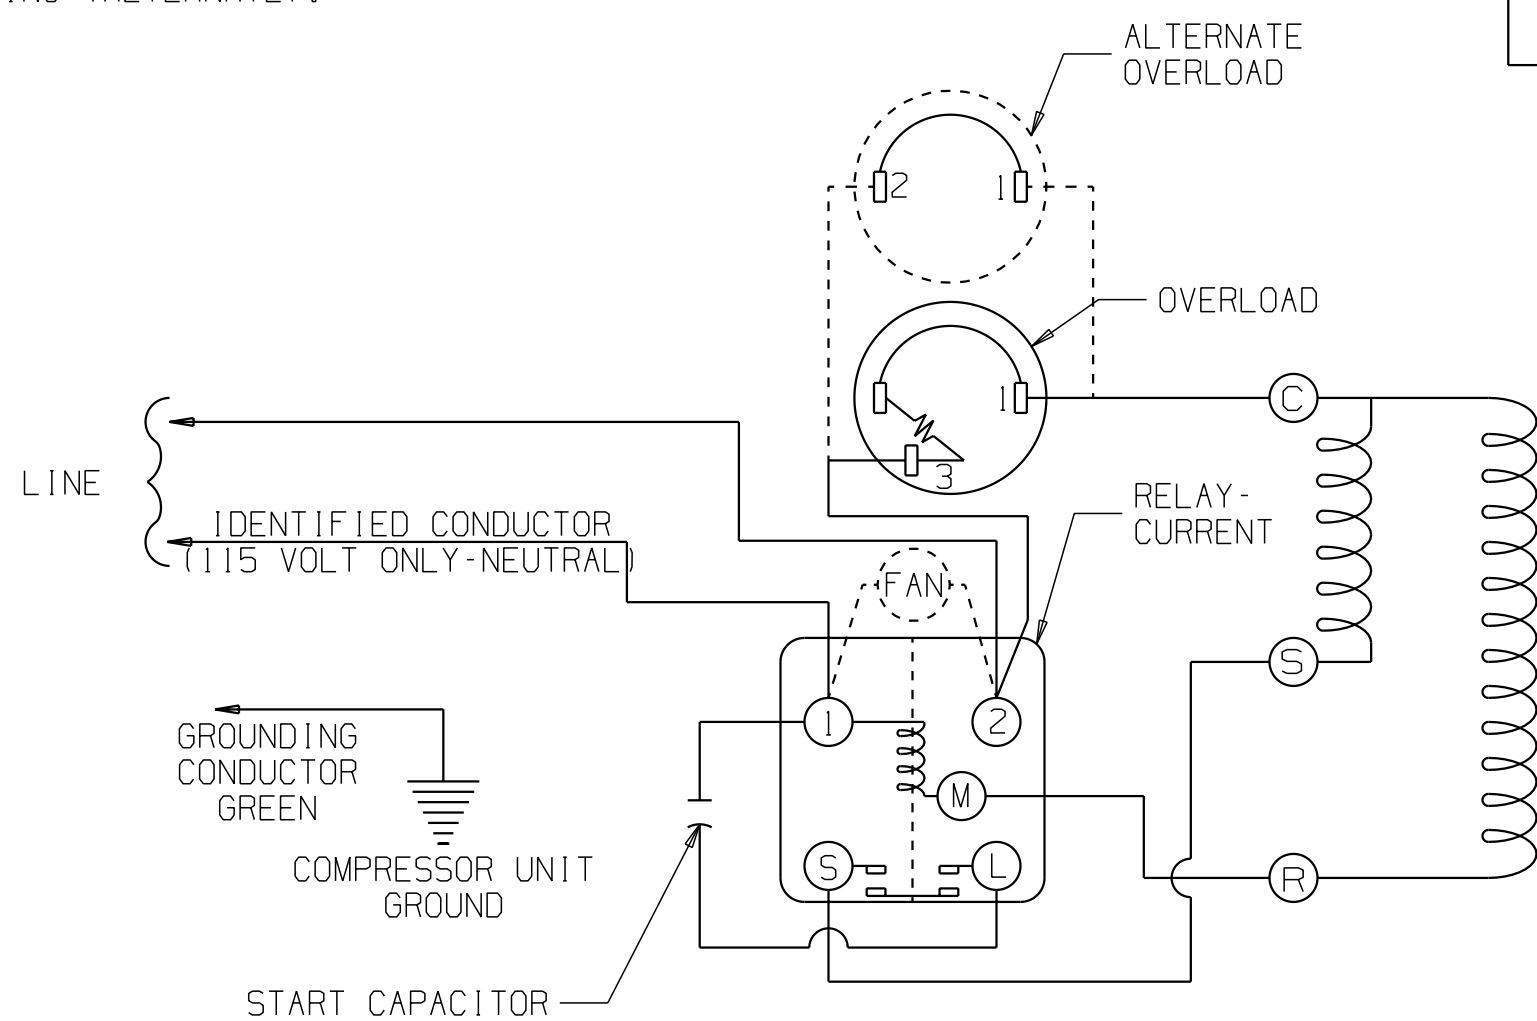

AK-115 OR 230 VOLT - CSIR - CURRENT RELAY

Q.A. SYMBOLS

AK

115 OR 230 VOLT-SCHEMATIC WIRING DIAGRAM -CSIR-
CURRENT RELAY
(REF.DWG. MD472-9)

[illegible]